


**Executive Order
G-70-154-AA**

Exhibit 2

Figure 2A-4
Typical Installation of the
Tokheim MaxVac Phase II Vapor Recovery System
With Two-Point Phase I System

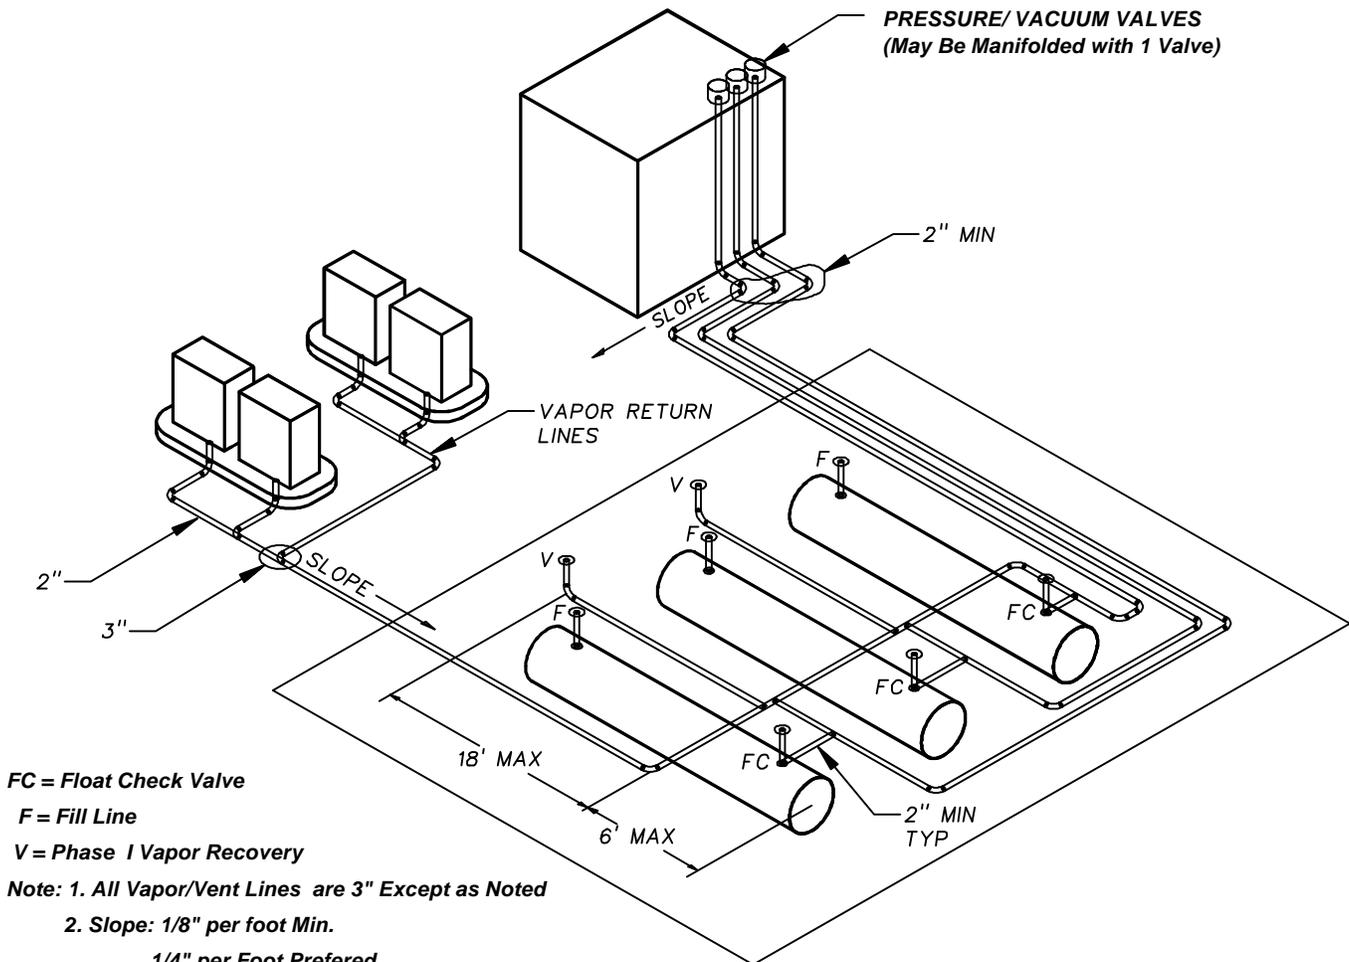

FC = Float Check Valve

F = Fill Line

V = Phase I Vapor Recovery

Note: 1. All Vapor/Vent Lines are 3" Except as Noted

2. Slope: 1/8" per foot Min.

1/4" per Foot Preferred

**3. Maintain 2'0" Clearance Between Fill Line and
Phase I Vapor Return Line to Delivery Truck**

**4. No less than one vapor return hose must be
connected for each product being delivered**