

**California Environmental Protection Agency  
AIR RESOURCES BOARD**

**Executive Order G-70-154-AA**

**Modification to the Certification of the  
Tokheim MaxVac Phase II Vapor Recovery System**

WHEREAS, the California Air Resources Board ("the Board" or "CARB") has established, pursuant to California Health and Safety Code sections 39600, 39601 and 41954, certification procedures for systems designed for the control of gasoline vapor emissions during motor vehicle fueling operations (Phase II vapor recovery systems) in its "CP-201 Certification Procedure for Vapor Recovery Systems of Dispensing Facilities" (the "Certification Procedures") as last amended April 12, 1996, incorporated by reference into Title 17, California Code of Regulations, Section 94011;

WHEREAS, the Board has established, pursuant to California Health and Safety Code sections 39600, 39601 and 41954, test procedures for determining the compliance of Phase II vapor recovery systems with emission standards in its "Certification and Test Procedures for Vapor Recovery Systems," CP-201.1 through CP-201.6 ("the Test Procedures") as adopted April 12, 1996, incorporated by reference into Title 17, California Code of Regulations, Section 94011;

WHEREAS, Tokheim Corporation ("Tokheim"), requested and was granted certification of the MaxVac Phase II vapor recovery system ("MaxVac system") pursuant to the Certification and Test Procedures on June 9, 1994 by Executive Order G-70-154;

WHEREAS, Tokheim requested modification of the MaxVac certification to include the Husky Model V34 6250 nozzle, the Husky V34 6200 nozzle, the Emco Wheaton Model A4505 nozzle, Catlow ICVN nozzle, Richards Astrovac nozzle, the Thomas Industries Model VF-0020 vapor pump and other components;

WHEREAS, the modification to the certification of the MaxVac system has been evaluated pursuant the Board's Certification Procedures;

WHEREAS, the Certification Procedures (CP-201) provides that the Executive Officer shall issue an order of certification if he or she determines that the vapor recovery system conforms to all of the applicable requirements set forth in the Certification Procedures;

WHEREAS, I, Michael P. Kenny, Air Resources Board Executive Officer, find that the MaxVac system conforms with all the requirements set forth in the Certification Procedures, and results in a vapor recovery system which is at least 95 percent effective for attendant and/or self-serve use at gasoline service stations when used in conjunction with a Phase I vapor recovery system which has been certified by the Board and meets the requirements contained in Exhibit 2 of this Order.

NOW, THEREFORE, IT IS HEREBY ORDERED that the MaxVac system when used with a CARB-certified Phase I system, as specified in Exhibits 1 and 2 of this Order, is certified to be at least 95 percent effective in attended and/or self-serve mode. **Compatibility of this system with the onboard vapor recovery systems ("ORVR") has not been evaluated to determine the emissions impact. Fugitive emissions which may occur when the underground storage tanks are under positive pressure have not been quantified and were not included in the calculation of system effectiveness.** Exhibit 1 contains a list of the equipment certified for use with the MaxVac system. Exhibit 2 contains installation and performance specifications for the system. Exhibit 3 contains a procedure for testing the static pressure integrity of the underground storage tank. Exhibit 4 contains a procedure for verifying dispensing rate.

IT IS FURTHER ORDERED that the dispensing rate for installations of the MaxVac system shall not exceed ten (10.0) gallons per minute when only one nozzle associated with the product supply pump is operating. This is consistent with the flowrate limitation imposed by United States Environmental Protection Agency as specified in the Federal Register, Volume 58, Number 55, page 16019. Dispensing rate shall be verified as specified in Exhibit 4.

IT IS FURTHER ORDERED that compliance with the certification requirements and rules and regulations of the Division of Measurement Standards of the Department of Food and Agriculture, the State Fire Marshal's Office, and the Division of Occupational Safety and Health of the Department of Industrial Relations is made a condition of this certification.

IT IS FURTHER ORDERED that the following requirements are made a condition of certification. The MaxVac system shall be installed only in facilities which are capable of demonstrating on-going compliance with the vapor integrity requirements contained in Exhibit 3 of this Order. The owner or operator of the installation shall conduct, and pass, a Static Pressure Decay test as specified in Exhibit 3, no later than 60 days after startup and at least once in each twelve month period. The owner or operator of the installation shall conduct, and pass, an Air-to-Liquid Ratio test as specified in TP-201.5 no later than 60 days after startup and at least once in each twelve month period thereafter. The test results shall be made available to the local air pollution control or air quality management district upon request within fifteen days after the tests are conducted, or within fifteen days of the request. Alternative test procedures may be used if determined by the Executive Officer, in writing, to yield comparable results.

IT IS FURTHER ORDERED that the MaxVac system, as installed, shall comply with the procedures and performance standards the test installation was required to meet during certification testing. If, in the judgment of the Executive Officer, a significant fraction of installations fail to meet the specifications of this certification, or if a significant portion of the vehicle population is found to have configurations which significantly impair the system's collection efficiency, the certification itself may be subject to modification, suspension or revocation.

IT IS FURTHER ORDERED that the certified MaxVac system shall, at a minimum, be operated in accordance with the manufacturer's recommended maintenance intervals and shall use the manufacturer's recommended operation, installation, and maintenance procedures.

IT IS FURTHER ORDERED that all nozzles approved for use with the MaxVac system shall be 100 percent performance checked at the factory, including checks of the integrity of the vapor and liquid path, as specified in Exhibit 2 of this Order, and of the proper functioning of all automatic shut-off mechanisms.

IT IS FURTHER ORDERED that each vapor pump shall be adjusted and 100 percent performance checked at the factory, including verification that the pump performance is within the range specified in Exhibit 2 of this Order.


IT IS FURTHER ORDERED that the certified MaxVac system shall be performance tested during installation for ability to dispense gasoline and collect vapors without difficulty, in the presence of the station manager or other responsible individual. Tokheim shall provide, to the station owner, operator or designee, CARB-approved copies of the installation and maintenance manuals along with instructions in the proper use of the MaxVac system, its repair and maintenance schedule, and where system and/or component replacements can be readily obtained, which are to be stored at the facility. Revisions to the manual are subject to approval by CARB.

IT IS FURTHER ORDERED that the certified MaxVac system shall be warranted by Tokheim, in writing, for at least one year, to the ultimate purchaser and each subsequent purchaser, that the vapor recovery system is designed, built and equipped so as to conform at the time of original installation or sale with the applicable regulations and is free from defects in materials and workmanship which would cause the vapor recovery system to fail to conform with applicable regulations. Tokheim shall provide copies of the manufacturer's warranty for the MaxVac system to the station manager, owner or operator. Hoses, nozzles and breakaway couplings shall be warranted to the ultimate purchaser as specified above for at least one year, or for the expected useful life, whichever is longer.

IT IS FURTHER ORDERED that any alteration of the equipment, parts, design, or operation of the systems certified hereby is prohibited, and deemed inconsistent with this certification, unless such alteration has been approved by the Executive Officer or his/her designee.

IT IS FURTHER ORDERED that the MaxVac certification Executive Order G-70-154, issued June 9, 1994, is hereby superseded by this Executive Order.

Executed at Sacramento, California, this 10<sup>th</sup> day of June, 1997.

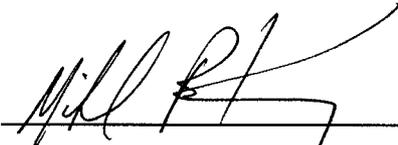  
\_\_\_\_\_  
Michael P. Kenny  
Executive Officer

Attachments

# Executive Order G-70-154-AA

## Exhibit 1

### MaxVac System Equipment List

<u>Component</u>	<u>Manufacturer / Model</u>	<u>State Fire Marshal Identification Number</u>
<b>Nozzles</b>	OPW 11VAI-xx (with vapor valve and Efficiency Compliance Device (ECD)) xx = 63 (15/16" OD spout, hold open latch (HOL)) 68 (13/16" OD spout, HOL) 83 (15/16" OD spout, no HOL) 88 (13/16" OD spout, no HOL) See Figure 2D-1	005:008:050
	Husky V34 Model 6200-5 (with vapor valve and ECD) See Figure 2D-2	005:021:008
	Husky V34 Model 6200 (with vapor valve and Vapor Splash Guard (VSG)) See Figure 2D-3	005:021:008
	Husky V34 Model 6250 (with vapor valve and (VSG)) See Figure 2D-4	005:021:008
	Emco Wheaton A4505 (with vapor valve and Vapor Guard) See Figure 2D-5	005:007:042
	Catlow ICVN (with vapor valve and ECD) See Figure 2D-6	005:030:014
	Richards Astrovac (with vapor valve and ECD) See Figure 2D-7	005:031:018

### **Splash Guards**

Splash guards are optional but, if used, must be the guards listed for use with the nozzle. Splash guards shall be installed so they do not interfere with the operation of the VEG or VSG units.

<u>Component</u>	<u>Manufacturer / Model</u>	<u>State Fire Marshal Identification Number</u>
<b>Inverted Coaxial Hoses</b>	Catlow Vapor Mate	005:033:005
	Dayco 7282 Superflex 2000	005:033:005
	Dayco 7292 Superflex 4000	005:033:006
	Dayco 7246 Flex-Ever Ultimate	005:033:007
	Goodyear Flexsteel	005:036:002
	GT Sales/Hewitt Superflex 2000	005:033:005
	Thermoid Hi-Vac	005:037:003
	Thermoid Hi-Vac S	005:037:004
	VST VSTaflex	005:052:001
	VST VST-CIS	005:052:001
		OR
	Any inverted coaxial hose which is CARB-certified for use with the MaxVac system	
<b>Breakaway Couplings</b>	<b>With A Vapor Poppet</b>	
	Catlow AV2001 (reconnectable)	005:030:006
	Catlow AVR200S (reconnectable)	005:030:010
	Emco Wheaton A5219-001 (reconnectable)	005:030:010
	Husky 4034 (reconnectable)	005:021:009
	OPW 66CIP (reconnectable)	005:030:010
	OPW 66CAS	005:008:056
	Richards VA-50 (reconnectable)	005:031:007
	Richards VA-50B (reconnectable)	005:031:014
	Richards VA-60	005:031:009
	VST-IS-SBK	005:044:008
VST-H-SBK	005:044:008	
	OR	
	Any inverted coaxial breakaway with a vapor valve which is CARB-certified for use with the MaxVac system.	
<b>Breakaway Couplings</b>	<b>Without A Vapor Poppet</b>	
	<b>(Note: These shall not be used after June 1, 2001.)</b>	
	Catlow AV200	005:030:005
	Catlow AV200-1	005:030:005
	Emco Wheaton A5019-001	005:030:005
	OPW 66CI	005:030:005
	Richards VA-51 (reconnectable)	005:031:007
Richards VA-61	005:031:009	

<u>Component</u>	<u>Manufacturer / Model</u>	<u>State Fire Marshal Identification Number</u>
<b>Breakaway/Hose Combinations</b>	VST-IS-BK (Breakaway includes a vapor poppet.)	005:044:004
	OR Any inverted coaxial breakaway/hose combination with a vapor valve which is CARB-certified for use with the MaxVac system.	
<b>Swivels</b>	Richards MFVA	005:031:015
	OR Any inverted coaxial swivel which is CARB-certified for use with the MaxVac system.	
<b>Breakaway/Swivel Combinations</b>	Richards STVA (Breakaway includes a vapor poppet.)	005:031:016
	OR Any inverted coaxial breakaway/swivel combination with a vapor valve which is CARB-certified for use with the MaxVac system.	
<b>Flow Control Units</b>	Catlow I10G-1A	005:030:013
	Husky 5837	005:021:012
	OPW 66FL	005:008:054
	OPW 66FD	005:008:054
	Richards FRVAD	005:031:017
	Vapor Systems Technologies (VST)	005:044:001
	OR Any inverted coaxial flow control unit which is CARB-certified for use with the MaxVac system.	
<b>Breakaway/Flow Control Unit Combinations</b>	OPW 66FLB (Breakaway includes a vapor poppet.)	005:008:055
	OR Any inverted coaxial breakaway/flow control unit combination with a vapor valve which is CARB-certified for use with the MaxVac system.	

<u>Component</u>	<u>Manufacturer / Model</u>	<u>State Fire Marshal Identification Number</u>
<b>Pressure/Vacuum Valves</b>	OPW 523LP, 523LPS (settings as specified below)	005:008:051
	Hazlett H-PVB-1 Gold label (settings as specified below)	005:017:004
	Morrison Brothers 749CRB0600 AV (settings as specified below)	005:041:001
	OR Any CARB-certified valve with the following pressure and vacuum settings, in inches water column (wc): <u>Pressure</u> : three plus or minus one-half inches (3.0 ± 0.5") water column. <u>Vacuum</u> : eight plus or minus two inches (8 ± 2") water column.	
<b>Vapor Pump</b>	Nuovo Pignone positive displacement roller pump/motor assembly Model Number: NFB 459002060	005:028:004
	Thomas Industries positive displacement vane pump/motor Model Number: VF-0020/991139	005:055:001
	OR Any vapor pump which is CARB-certified for use with the MaxVac system.	
<b>Dispensers</b>	<u>Premier Series Dispensers:</u>	
	H3nn/suffix	
	H4nn/suffix	
	H7nn/suffix where:	
	"H" in main body = High hose	
	3, 4, or 7 in prefix indicates dispenser width [3(30"), 4(45"), 7(45")]	
	"nn" = (# of sides & # of hoses per dispenser) [11, 12, 13, 14, 22, 24, 26, 28]	
	"B" in suffix = Premier Series	
	"R" in suffix = Remote Dispenser	
	"B3", "B4", "B5" in suffix = 3, 4, or 5 Product Blender	
"EB" in suffix = Electronic Blender		
"MV" = MaxVac.		

**State Fire Marshal  
Identification Number**

**Component**

**Manufacturer / Model**

**MaxVac Retrofit Kits**

Kit Model Numbers:  
prefix/xxx/y/MVK/GR/z where:  
"prefix" = H or blank  
"xxx" = 300, 400, or 600  
"y" = A for TCS-A or B for Premier (Generation of Electronics)  
"MVK" = MaxVac Kit.  
'GR" = Group  
"z" = any digit(s)

Note: KITS SHALL BE USED ONLY WITH:  
Premier Series Dispensers as listed above without the "MV"  
designation OR TCS-A Series Dispensers:  
prefix/xxxAR/suffix  
"prefix" = H or blank, "A" = TCS-A Series,  
"R" = Remote Dispenser  
"xxx" = 311, 312, 322, 324, 411, 413, 422, 426, 614, 628  
"suffix" = B3 for 3 product blender, B5 for 5 product blender,  
EB for Electronic Blender.

OR  
Any dispenser which is CARB-certified for use with the MaxVac  
system.

**Phase I Adaptors**

Any CARB-certified device which prevents loosening or overtightening  
of the Phase I product and vapor adaptors.

Note: For systems installed before two CARB-certified devices which  
prevent loosening or overtightening of the Phase I product and vapor  
adaptors are available, or within sixty days after that date, any  
CARB-certified Phase I product adaptor may be used for a period not  
to exceed four years from the date the second device was certified.

# Executive Order G-70-154-AA

## Exhibit 2

### Specifications for the MaxVac Bootless Nozzle System

Figures 2A contain drawings of a typical installation of the MaxVac system. Figures 2B and 2C depict the operation and location of component parts of the MaxVac system. Figures 2D-1 through 2D-7 depict the nozzles approved for use with the MaxVac system. Figure 2E depicts instructions on conducting air-to-liquid ratio testing with the Husky V34 6250 nozzle and the MaxVac system.

#### **Nozzles**

1. **OPW 11VAI and Husky V34 6200-5**

An Efficiency Compliance Device (ECD) shall be installed on the OPW 11VAI and Husky V34 6200-5 nozzles at the base of the spout, as shown in Figure 2D-1 and 2D-2. Any OPW 11VAI or Husky V34 6200-5 nozzle with an ECD which is missing, or which is damaged such that at least one-fourth (1/4) of the circumference is missing, or which has cumulative damage equivalent to at least 1/4 of the circumference missing, is defective and shall be immediately removed from service.

2. **OPW 11VAI**

The OPW 11VAI nozzle may use either an aluminum spout or a stainless steel spout. The aluminum spout has a total of 12 vapor recovery holes while the stainless steel spout has a total of 18 vapor recovery holes. Figure 2D-1 shows a typical 11VAI nozzle with an aluminum spout configuration.

3. **Husky V34 6200 and V34 6250**

A Vapor Splash Guard (VSG) shall be installed on the Husky V34 6200 and V34 6250 nozzles at the base of the spout, as shown in Figures 2D-3 and 2D-4.

- **Damaged or Missing VSG**

Any Husky V34 6200 and V34 6250 nozzle with a VSG which is missing, or which is damaged such that at least a one and one-half (1.5) inch slit has developed, or which has cumulative damage equivalent to at least a 1.5 inch slit, is defective and shall be immediately removed from service.

- **Holes in VSG**

Any Husky V34 6200 and V34 6250 nozzle which is damaged such that greater than a three-eighths (3/8) inch hole has developed, or which has cumulative damage greater than a 3/8 inch hole, is defective and shall be immediately removed from service. Nozzles installed and in service prior to the issue date of this Executive Order may have a VSG with one one-eighth (1/8) inch hole, or may be modified to have four (4) three-sixteenth (3/16) inch holes, which are equivalent to in area to a 3/8 inch hole.

- **Compression of VSG**

Any Husky V34 6200 and V34 6250 nozzle which has a VSG compressing more than one-half (0.5) inches when a compression force of at least 1.5 pounds is applied is defective and shall be immediately removed from service. (Note: do not include the compression length of the VSG "flange".)

4. **Emco Wheaton A4505**

A Vapor Guard (VG) shall be installed on the Emco Wheaton A4505 nozzle at the base of the spout, as shown in Figure 2D-5. Any Emco Wheaton A4505 nozzle with a VG which is completely missing is defective and shall be immediately removed from service.

5. **Catlow ICVN and Richards Astrovac**

An Efficiency Compliance Device (ECD) shall be installed on the Catlow ICVN nozzle and Richards Astrovac nozzle at the base of the spout, as shown in Figures 2D-6 and 2D-7. Any Catlow ICVN or Richards Astrovac nozzle with an ECD which is damaged such that at least one-fourth (1/4) of the circumference is missing, or which has cumulative damage equivalent to at least 1/4 of the circumference missing, is defective and shall be immediately removed from service

6. Failure mode testing demonstrated that blockage of some of the vapor collection holes in the spout of the nozzle has negligible effect on the operation of the system until the number of unblocked holes is less than required below. The Husky V34 6250 nozzle uses a solid spout design which does not have any vapor collection holes on the tip of the spout. Gasoline vapors are directed to the base of the spout by the VSG where they can be collected by the MaxVac system.

Nozzle	Minimum Number of <u>Unblocked</u> Vapor Holes Required
OPW 11VAI	2
Husky V34 6200-5	2
Husky V34 6200	2
Husky V34 6250	N/A
Emco Wheaton A4505	7
Catlow ICVN	4
Richards Astrovac	4

7. The nozzles shall have an integral vapor valve which prevents the loss of vapor from the underground storage tanks, ensures proper operation of the system and prevents the ingestion of air into the system when another nozzle which is connected to the same vapor pump is used. Any nozzle with a defective vapor valve will substantially impair the effectiveness of the other nozzles associated with the same vapor pump. Therefore, any nozzle with a defective vapor valve, and all nozzles at the same fueling point (dispenser side), shall be immediately removed from service and the vapor path shall be closed as soon as practicable.

NOTE: A defective vapor valve will also impair the integrity of the system and may result in vapor loss from or air ingestion into the underground storage tank.

8. Nozzles shall be 100 percent performance checked at the factory, including checks of all shutoff mechanisms and of the integrity of the vapor path. The maximum allowable leak rate for the nozzle shall not exceed the following:

0.038 CFH at a pressure of two inches water column (2" wc), and  
0.005 CFH at a vacuum of twenty seven inches water column (approx. 1 psi).

9. Leaded and unleaded spouts are interchangeable.

10. Sealing of the vapor holes on the nozzle spout (such as placing a balloon or the fingers of a glove over the holes on the nozzle spout, or bagging nozzles) is not permitted during static pressure decay tests. Sealing of the nozzle vapor holes during a static pressure decay test may mask a defective vapor valve.

### **Dispensing Rate**

1. The dispensing rate for installations of the MaxVac system shall not exceed 10.0 gallons per minute when only one nozzle associated with the product supply pump is operating. This shall be determined as specified in Exhibit 4.

### **Inverted Coaxial Hoses**

1. The length of hose which may be in contact with the island and/or ground when the nozzle is properly mounted on the dispenser is limited to six inches (6").
2. The hose configuration shall comply with Figure 2B; there may be 1 to 4 hoses on each side of the dispenser. Within the constraints of the configurations, the maximum length of the hose shall be fifteen feet (15').

### **Breakaway Couplings**

1. Breakaway couplings are optional but, if installed, only CARB-certified breakaways may be used. CARB-certified breakaway couplings which do not close the vapor path and are listed in Exhibit 1 of this Executive Order may only be used until 4 years following the date of signature of this Executive Order.
2. The following section does not apply to breakaways that contain a valve which closes the vapor path when it is separated. Operation of the system, when a breakaway coupling is separated, will substantially reduce the effectiveness of the other nozzles at that fueling point (dispenser side). Separated breakaways shall be recoupled, or the vapor path plugged, as soon as possible. Other nozzles at the fueling point shall not be used when such a breakaway is separated.

NOTE: A separated breakaway will also impair the integrity of the system and may result in vapor loss from or air ingestion into the underground storage tanks.

### **Pressure/Vacuum Valves for Storage Tank Vents**

1. A pressure/vacuum (P/V) valve shall be installed on each tank vent. Vent lines may be manifolded to minimize the number of P/V valves and potential leak sources, provided the manifold is installed at a height not less than 12 feet above the driveway surface used for Phase I tank truck filling operations. At least one P/V valve shall be installed on manifolded vents. If two P/V valves are desired, they shall be installed in parallel, so that each can serve as a backup for the other if one should fail to open properly. The P/V valve shall be a CARB-certified valve as specified in Exhibit 1. The outlets shall vent upward and be located to eliminate the possibility of vapor accumulating or traveling to a source of ignition or entering adjacent buildings.
2. The P/V valve is designed to open at a pressure of approximately three inches water column (3" wc). Storage tank pressure which exceeds 3" wc for more than a short time may indicate a malfunctioning pressure/vacuum vent valve.

**MaxVac System**

1. The A/L ratio of the system measured at a flowrate between seven and ten gallons per minute (7 - 10 gpm), shall be within the values listed in the following table. Any fueling point not capable of demonstrating compliance with this performance standard shall be deemed defective and removed from service. The A/L ratio shall be determined by using the CARB-approved procedure TP-201.5. Alternative test procedures may be used if they are determined by the Executive Officer, in writing, to yield comparable results. Figure 2F and illustrates the correct configuration for including or excluding the shut-off port. Husky shall provide instructions on how to conduct A/L testing similar to the instructions listed in Figure 2E.

Nozzle	Shut-off Port	A/L Installation	A/L Ratio
OPW VAI	excluded	Figure 2F	<b>0.90 to 1.10</b>
Husky V34 6200-5	included	Figure 2F	
Husky V34 6200	included	Figure 2F	
Husky V34 6250	excluded	Figure 2E	
Emco Wheaton	excluded	Figure 2F	
Catlow ICVN	excluded	Figure 2F	
Richards Astrovac	excluded	Figure 2F	

NOTE: This test procedure returns air rather than vapor to the storage tank, and normally causes an increase in storage tank pressure which may result in vent emissions. This is a temporary condition due to the test and should not be considered an indication of malfunction or noncompliance.

2. The MaxVac system shall be equipped with electronic safeguards designed to ensure that no fuel is dispensed unless the MaxVac system is operating properly. An error code is indicated on the sales display of the dispenser which identifies the problem as being related to the MaxVac system.

The following conditions shall halt or inhibit the operation of the one side of the dispenser, with an error code indicated, while allowing the other side to operate.

- Excessive vapor pump motor current (possible causes include bearing failure, locked rotor, motor winding shorts or fluid in pump cavity for more time than required to clear a blockage).
- Failure of the vapor pump to start while fuel is being dispensed (possible causes include control electronics failure, disconnected or severed motor wiring, or locked rotor).
- Failure or loss of the MaxVac system power supply.
- Open circuit breaker.
- Cabling/wiring missing or disconnected (tampering).

### **Vapor Recovery Piping Configurations**

1. The recommended maximum pressure drop through the system, measured at a flow rate of 60 SCFH with dry Nitrogen gas, is 0.05 inches water column. The maximum allowable pressure drop through the system shall never exceed one-half inch (0.5") water column at 60 SCFH. The pressure drop shall be measured from the dispenser riser to the UST with pressure/vacuum valves installed and with the poppeted Phase I vapor connection open.
2. All vapor return lines shall slope a minimum of 1/8 inch per foot. A slope of 1/4 inch or more per foot is recommended wherever feasible.
3. The dispenser shall be connected to the riser with either flexible or rigid material which is listed for use with gasoline. The dispenser-to-riser connection shall be installed so that any liquid in the lines will drain toward the UST. The internal diameter of the connector, including all fittings, shall be not less than three-fourths inch (3/4").
4. All vapor return and vent piping shall be installed in accordance with the manufacturer's instructions and all applicable regulations.
5. No product shall be dispensed from any fueling point associated with a vapor line which is disconnected and open to the atmosphere. If vapor lines are manifolded, this includes all fueling points in the facility.
6. The recommended nominal inside diameter of the underground Phase II plumbing is as indicated in Figures 2A-1 through 2A-4. Smaller vapor lines are not recommended but may be used provided the pressure drop criteria specified above are met. The vapor return lines shall be manifolded below grade at the tanks as indicated in the figures.

Exception: For installations with a vapor return line directly to only one tank, and for which a manifold on the tank vents will be used to provide part of the vapor return path to other tanks, the vent manifold may be used as an alternative to the underground manifold only in existing installations where the vapor piping is already installed, and shall not be used in "new" installations where vapor piping is being installed. For installations with dedicated vapor piping directly to each tank, the vent manifold is approved for both new and existing installations and an additional tank manifold below grade is optional but not required.

### **Phase I System**

**WARNING:** Phase I fill caps should be opened with caution because the storage tank may be under pressure.

1. The Phase I system shall be a CARB-certified system which is in good working order and which demonstrates compliance with the static pressure decay test criteria contained in Exhibit 3 of this Order. Coaxial Phase I systems shall not be used with new installations of the system. Replacement of storage tanks at existing facilities, or modifications which cause the installation of new or replacement Phase I vapor recovery equipment, are considered new installations with regard to this prohibition. An exception to this prohibition may be made for coaxial Phase I systems CARB-certified after January 1, 1994, as compatible for use with Phase II systems which require pressure/vacuum vent valves. Where installation of the MaxVac system is made by retrofitting previously installed equipment, local districts may elect to allow existing coaxial Phase I systems to remain in use for a specifically identified period of time provided the following conditions are met:


- the existing coaxial Phase I system is a poppeted, CARB-certified system capable of demonstrating compliance with the static pressure decay test as specified above; and
  - installation of the Phase II system requires no modification of the UST(s) and/or connections.
2. Spill containment manholes which have drain valves shall demonstrate compliance with the static pressure decay criteria with the drain valves installed as in normal operation. Manholes with cover-actuated drain valves shall not be used in new installations (as defined above). Manholes with cover-actuated drain valves may remain in use in facilities where installation of the MaxVac system does not require modification of the tank fittings provided the facility demonstrates compliance with static pressure decay test criteria both with the cover open and with the cover closed.
  3. The Phase I vapor recovery system shall be operated during product deliveries so as to minimize the loss of vapors from the facility storage tank which may be under pressure. Provided it is not in conflict with established safety procedures, this may be accomplished in the following manner:
    - the Phase I vapor return hose is connected to the delivery tank and to the delivery elbow before the elbow is connected to the facility storage tank;
    - the delivery tank is opened only after all vapor connections have been made, and is closed before disconnection of any vapor return hoses; and
    - the vapor return hose is disconnected from the facility storage tank before it is disconnected from the delivery tank.
  4. Phase I deliveries shall be accomplished so as to ensure that there is at least one vapor connection between the cargo tank compartment headspace and the storage tank associated with the product delivery. There shall be no more than two product hoses used with one with one vapor hose connected, and no more than three product hoses used with two vapor hoses connected.
  5. Storage tank vent pipes, and fill and vapor and manhole tops, shall be maintained white, silver or beige. Colors which will similarly prevent heating of the system due to solar gain may also be used, provided they are listed in EPA AP-42 as having a factor the same as or better than that of the colors listed above. Existing facilities which were installed before April 1, 1996, must be in compliance with this requirement no later than January 1, 1998. Manhole covers which are color coded for product identification are exempted from this requirement.

# Executive Order G-70-154-AA

## Exhibit 2

### Figure 2A-1

#### Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

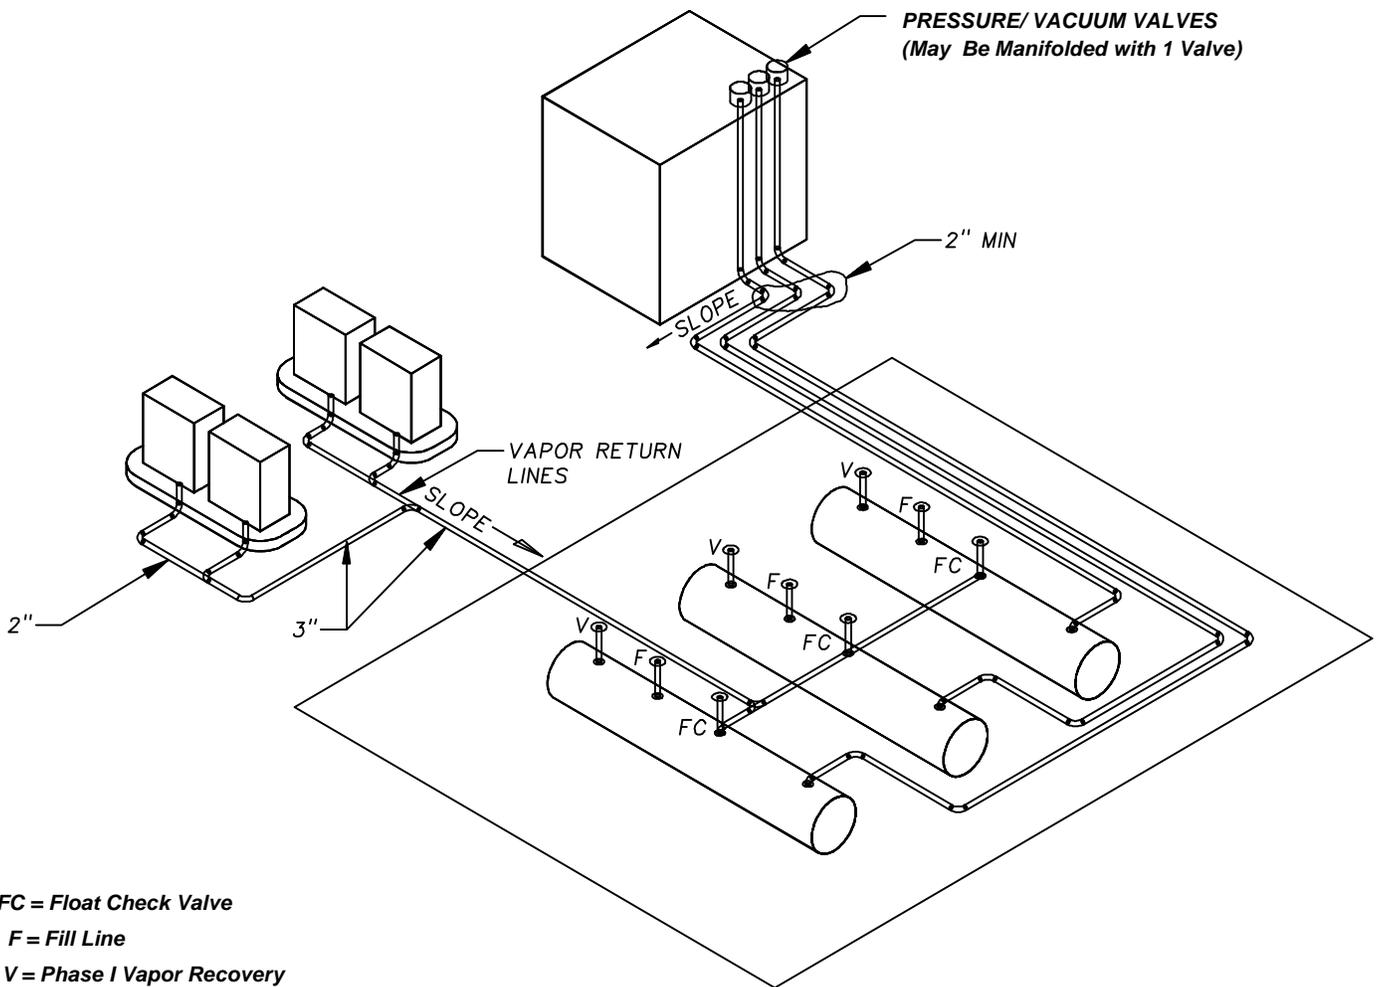

**FC = Float Check Valve**

**F = Fill Line**

**V = Phase I Vapor Recovery**

**Note: 1. All Vapor/Vent Lines are 3\"/>**

**2. Slope: 1/8\"/>**

**1/4\"/>**


**3. Maintain 2'0\"/>**

# Executive Order G-70-154-AA

## Exhibit 2

### Figure 2A-2

#### Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

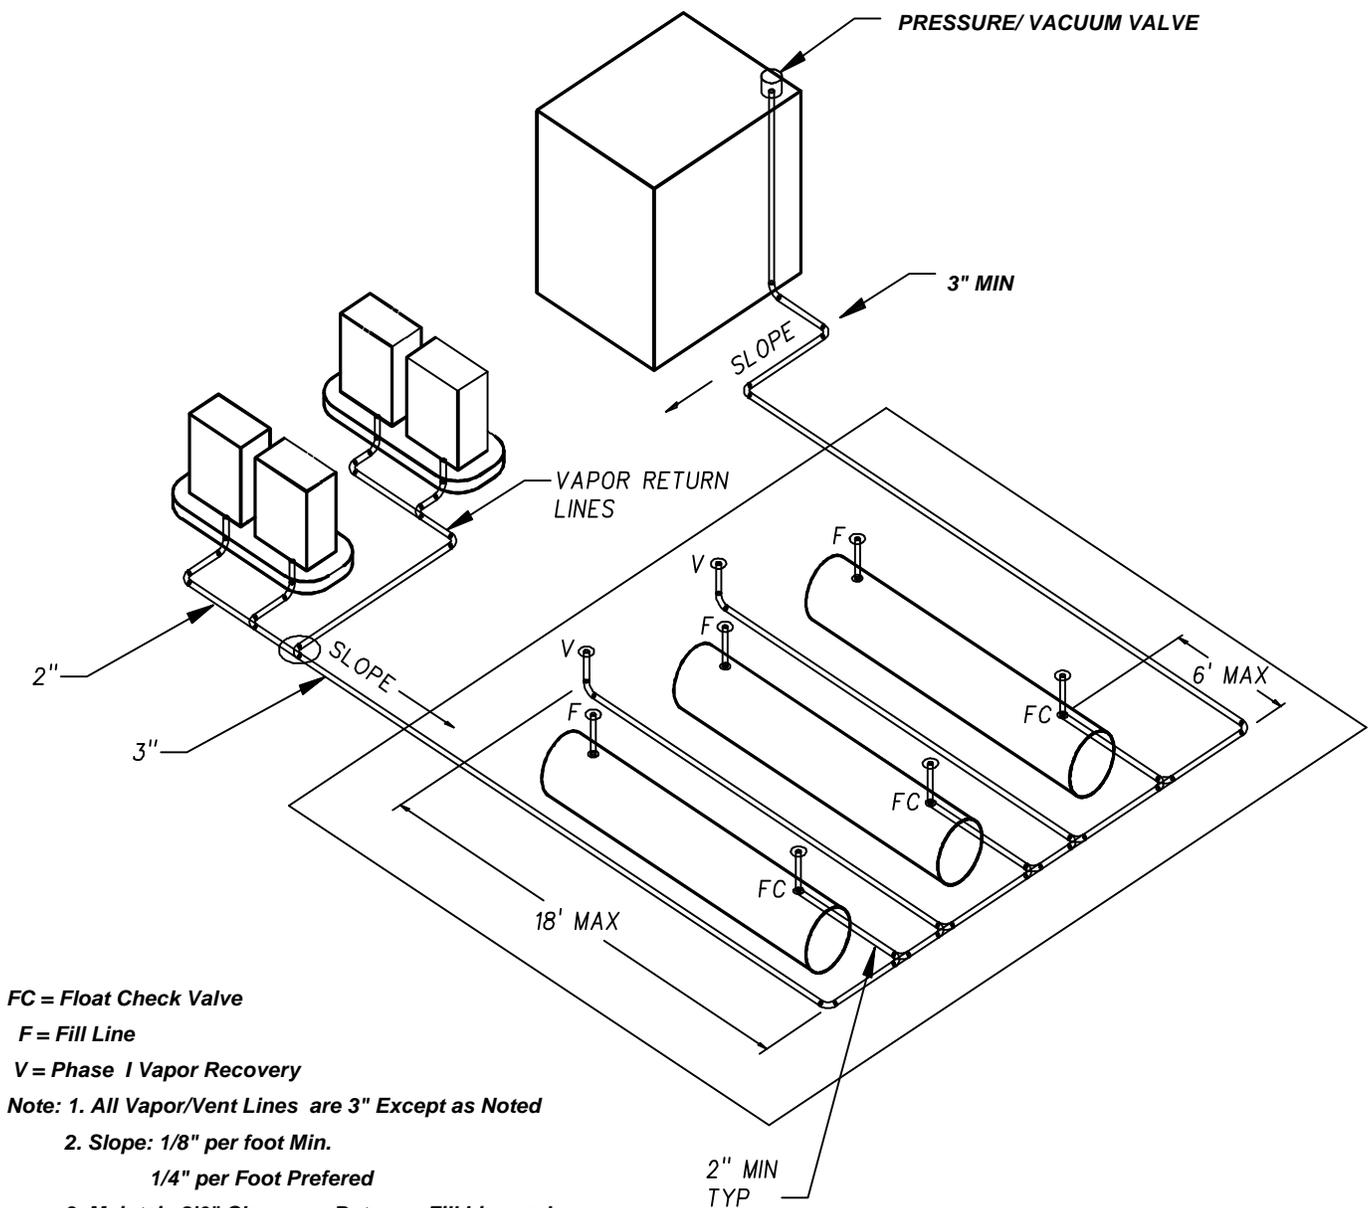


# Executive Order G-70-154-AA

## Exhibit 2

### Figure 2A-3


#### Typical Installation of the Tokheim MaxVac Phase II Vapor Recovery System With Two-Point Phase I System

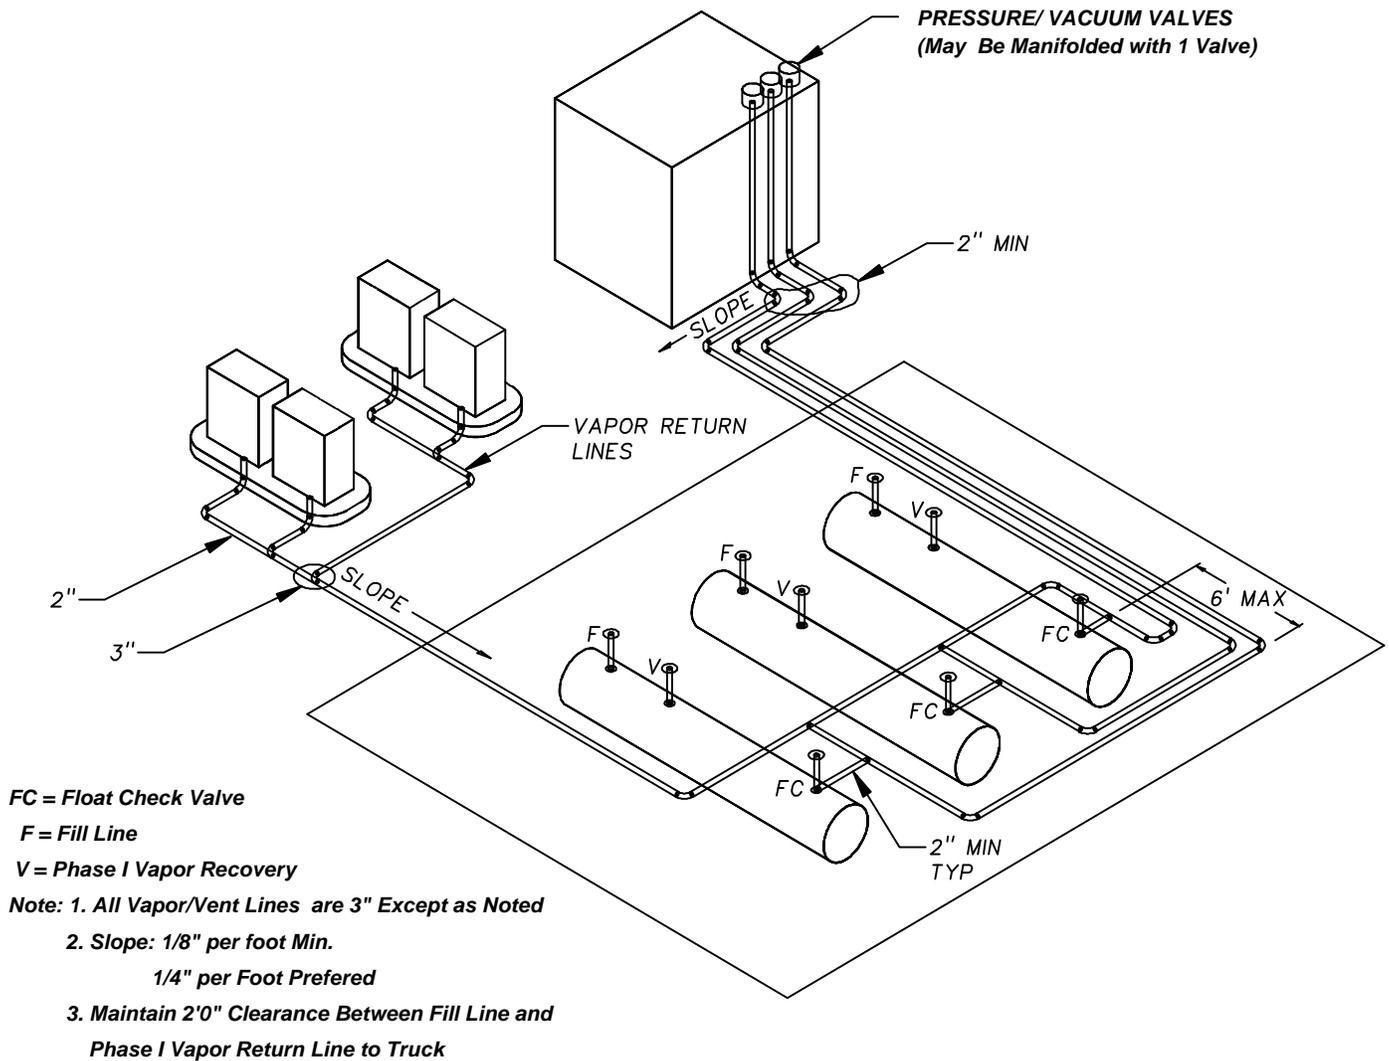

**Executive Order  
G-70-154-AA**

**Exhibit 2**

**Figure 2A-4**  
Typical Installation of the  
Tokheim MaxVac Phase II Vapor Recovery System  
With Two-Point Phase I System

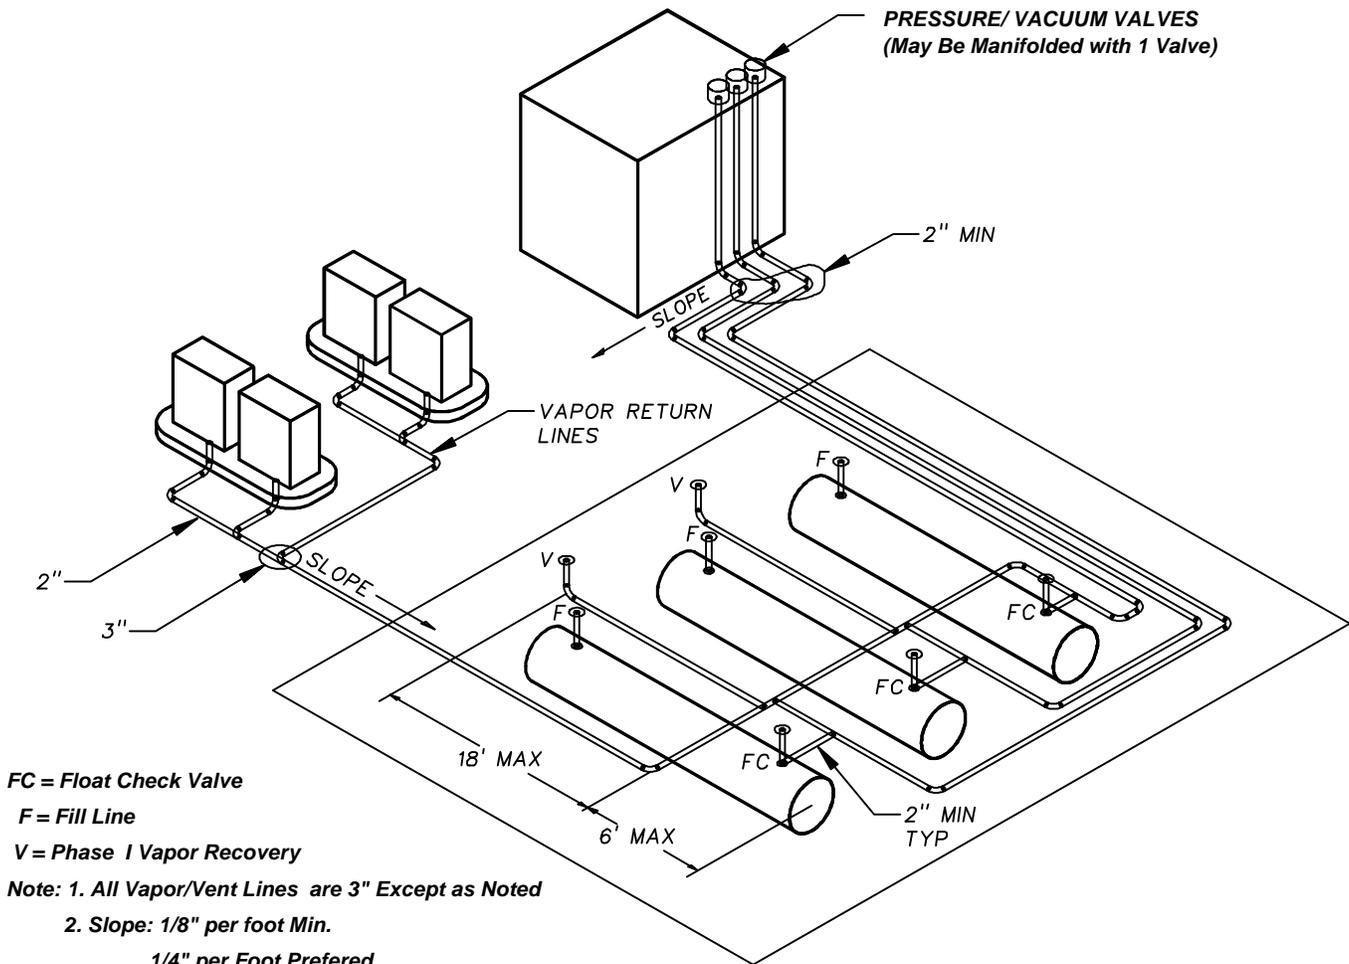

Executive Order  
G-70-154-AA


Exhibit 2

Figure 2B

MaxVac System Operational Diagram

# MaxVac<sup>®</sup>

## STAGE II Vacuum Assist System

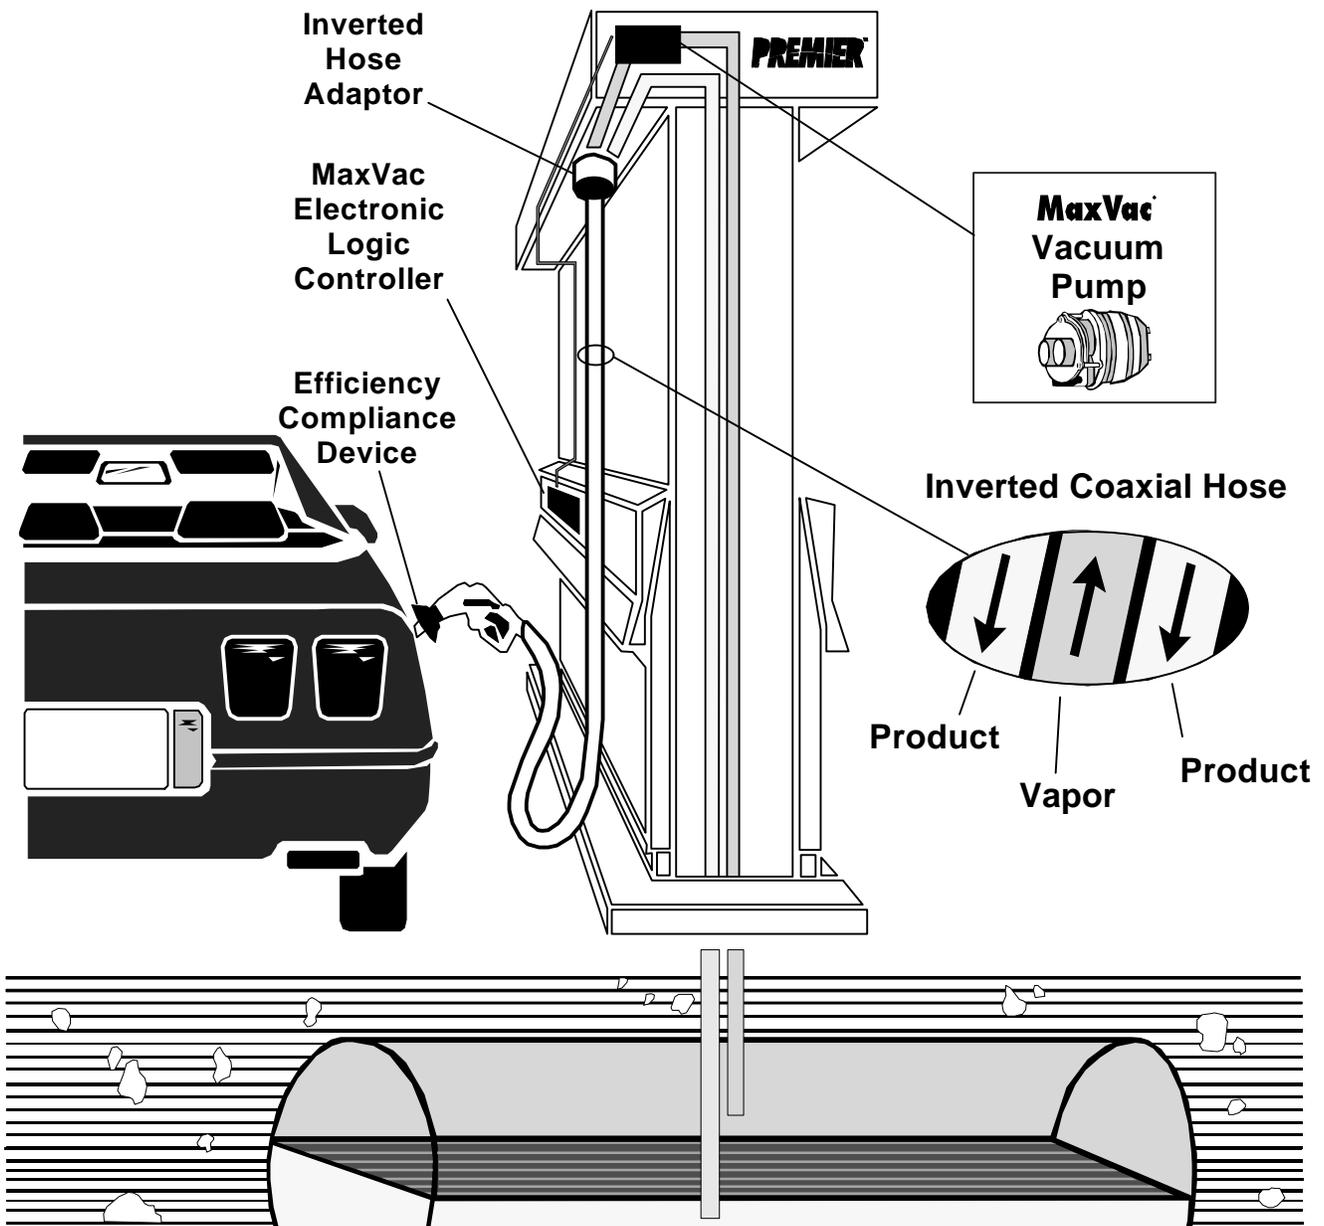


**Executive Order G-70-154-AA**

**Exhibit 2**

**Figure 2C**

**Possible Configurations - MaxVac System**

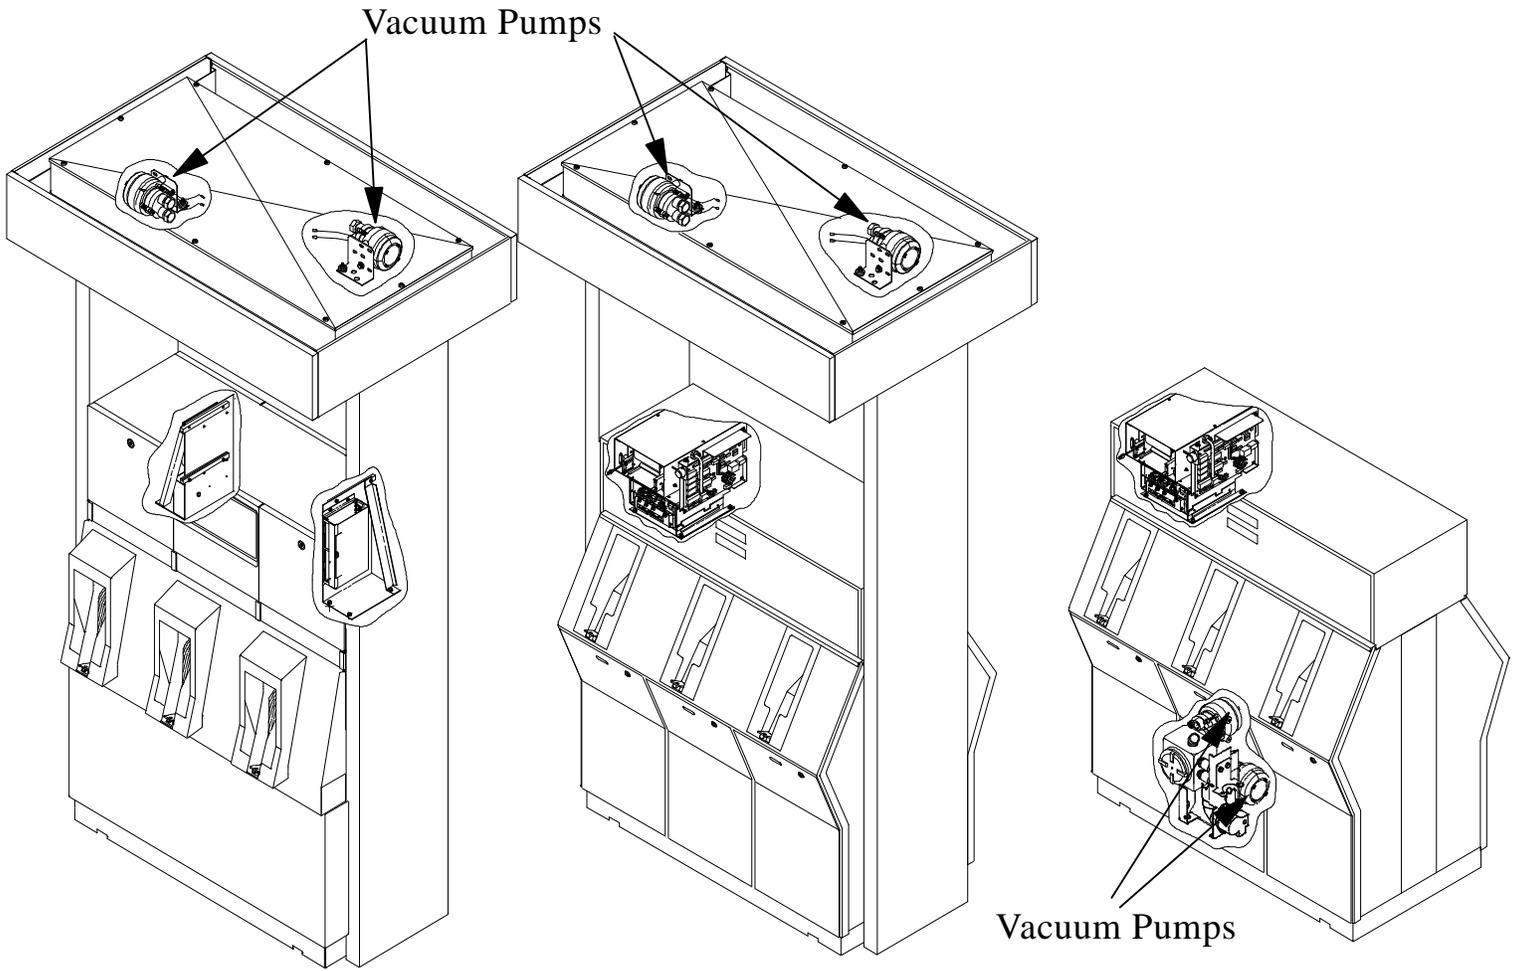

Premier Dispenser  
Production & Retrofit  
Models

TCS-A Dispenser  
Retrofit  
High Hose Models

TCS-A Dispenser  
Retrofit  
Low Hose Models


Dispenser can be One, Two, Three, or Four Hoses per Dispenser Side

Executive Order G-70-154-AA

Exhibit 2

Figure 2D-1

OPW Model 11VAI-XX for  
the Tokheim MaxVac System

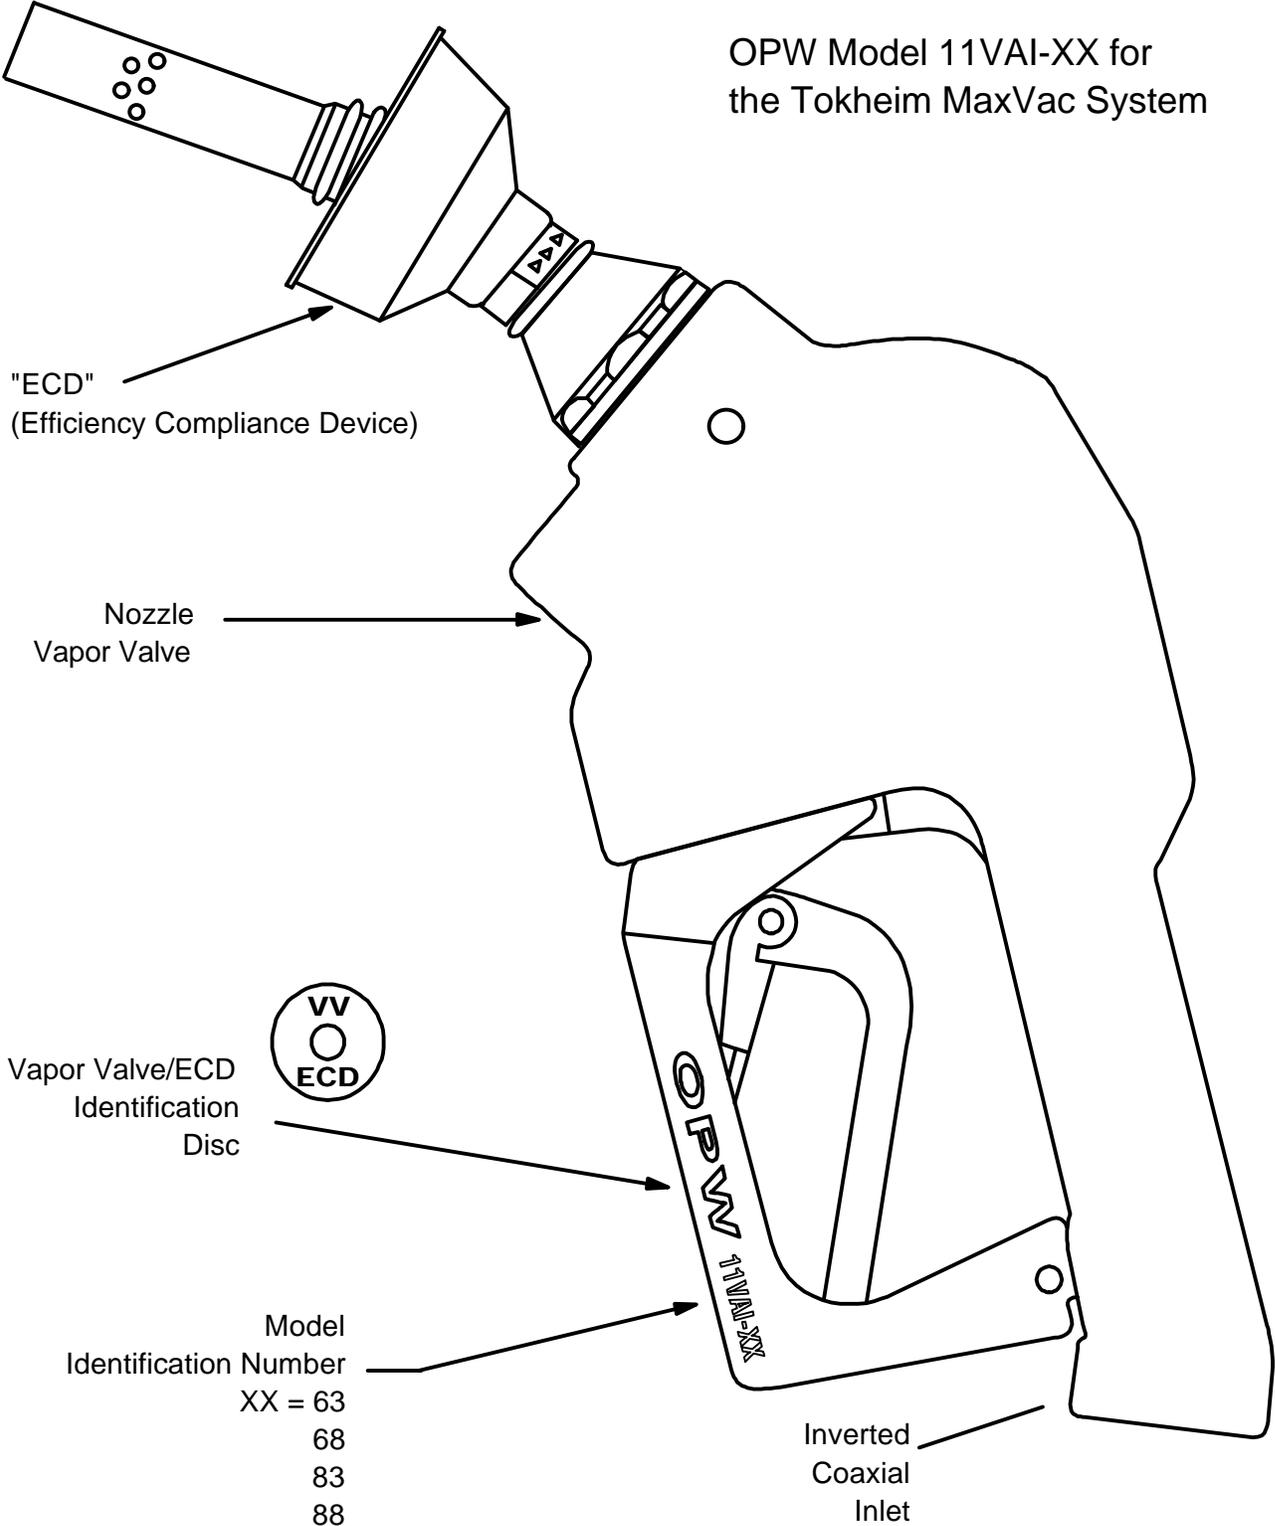


**Executive Order G-70-154-AA**

**Exhibit 2**

**Figure 2D-2**

Husky Model V34 6200-5 for  
the Tokheim MaxVac System

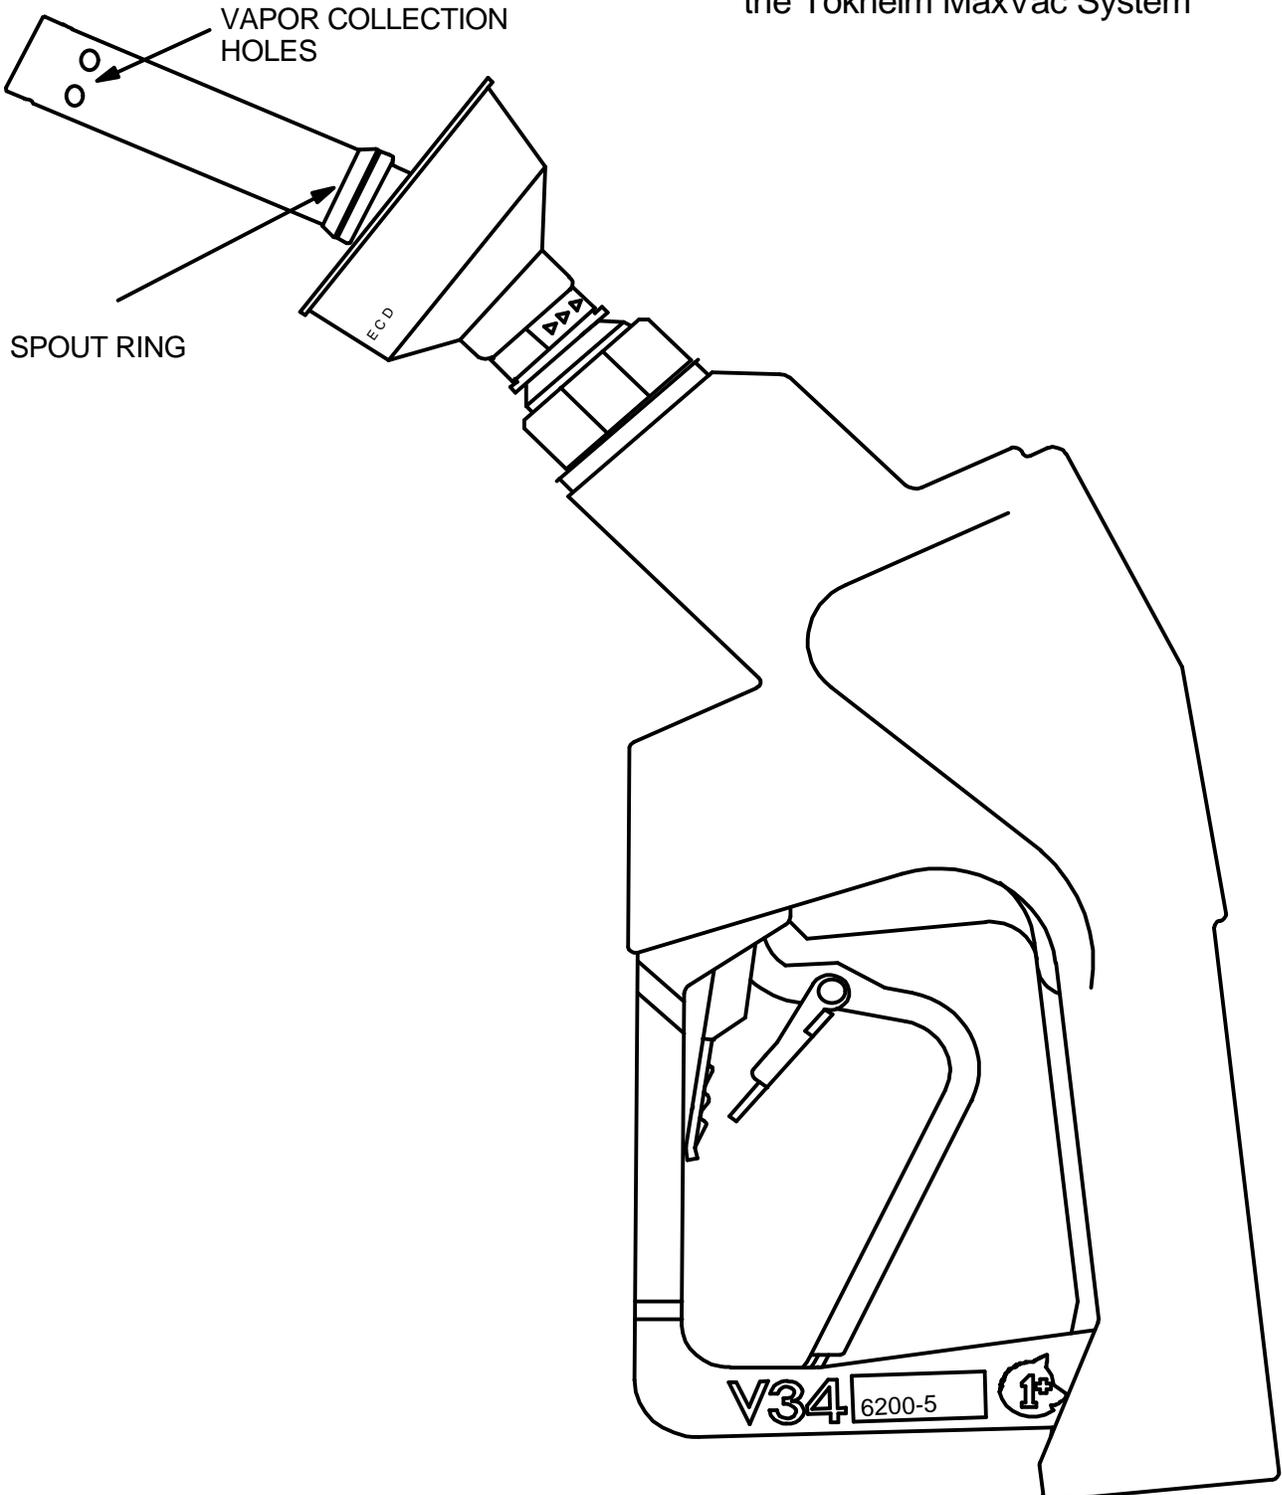


Executive Order G-70-154-AA

Exhibit 2

Figure 2D-3


Husky Model V34 6200 for  
the Tokheim MaxVac System

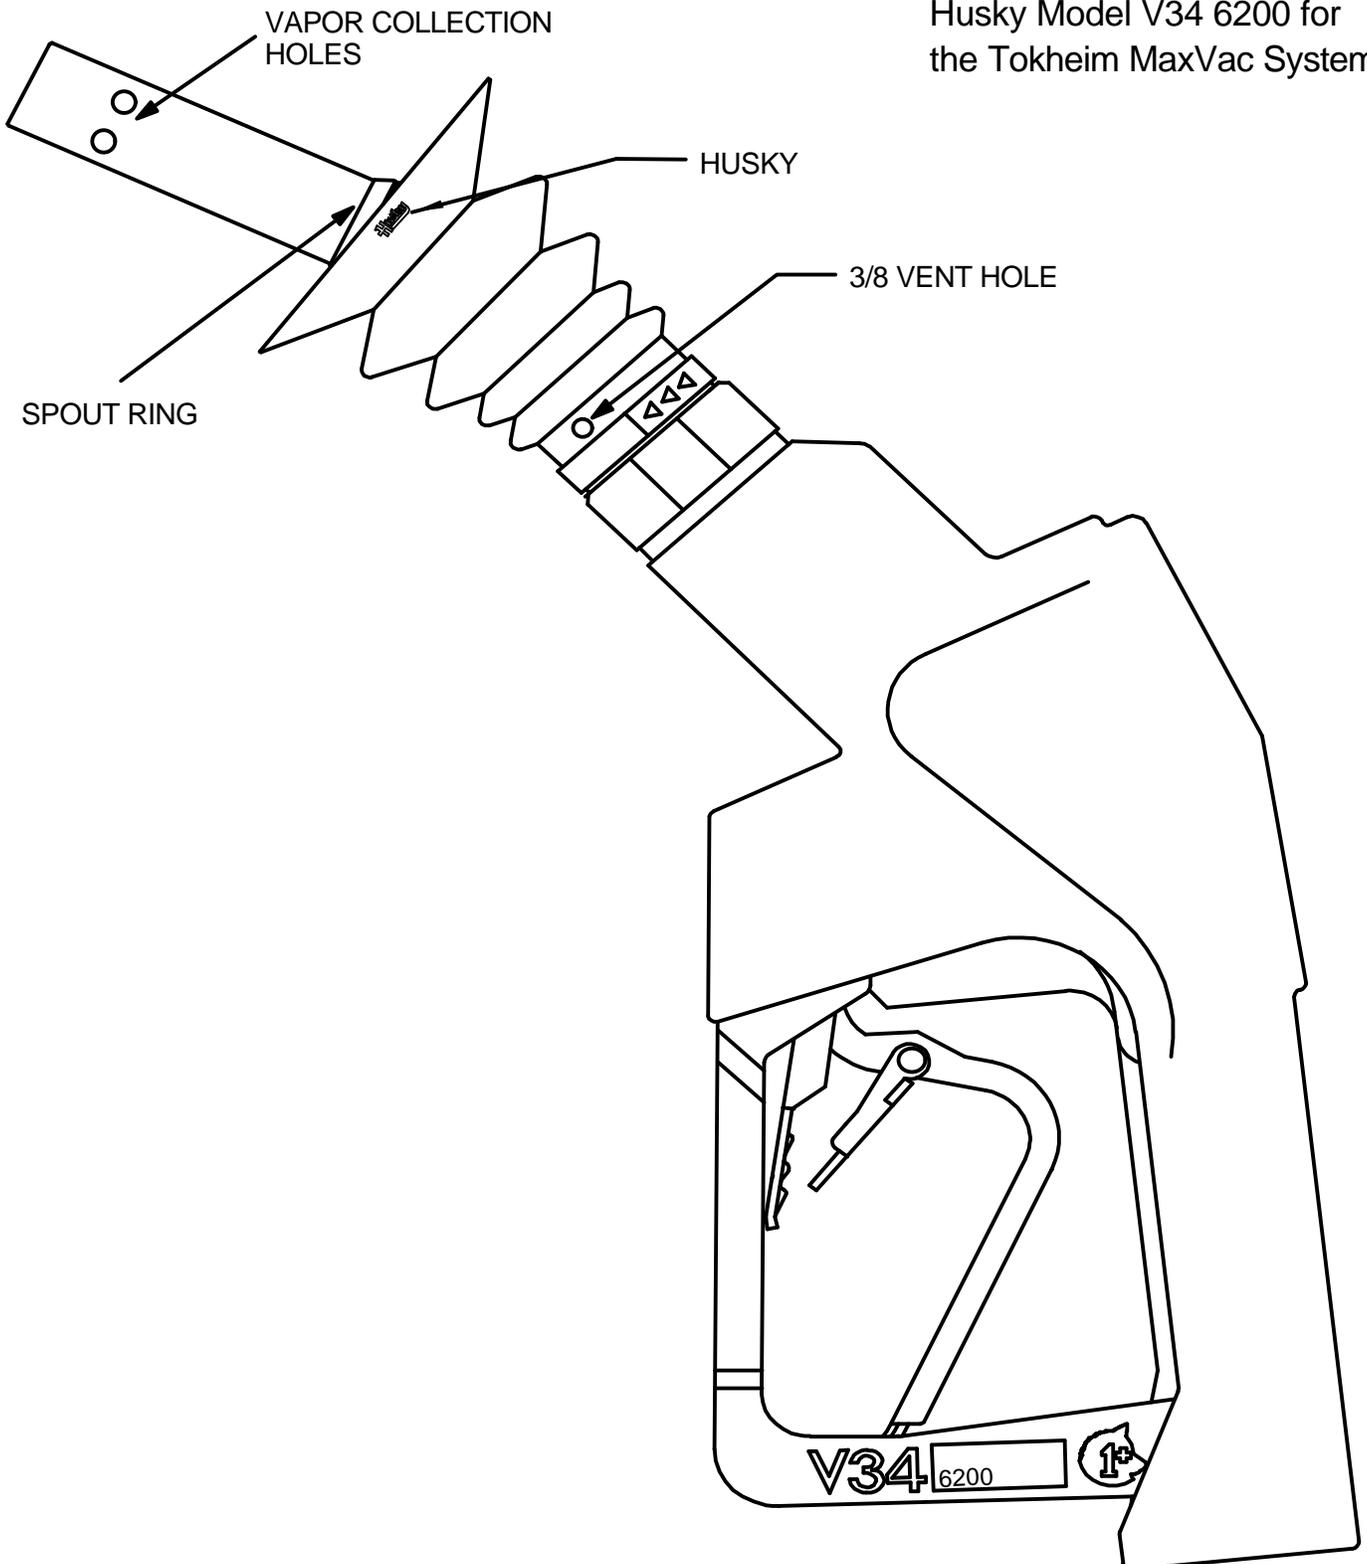

Executive Order G-70-154-AA

Exhibit 2

Figure 2D-4

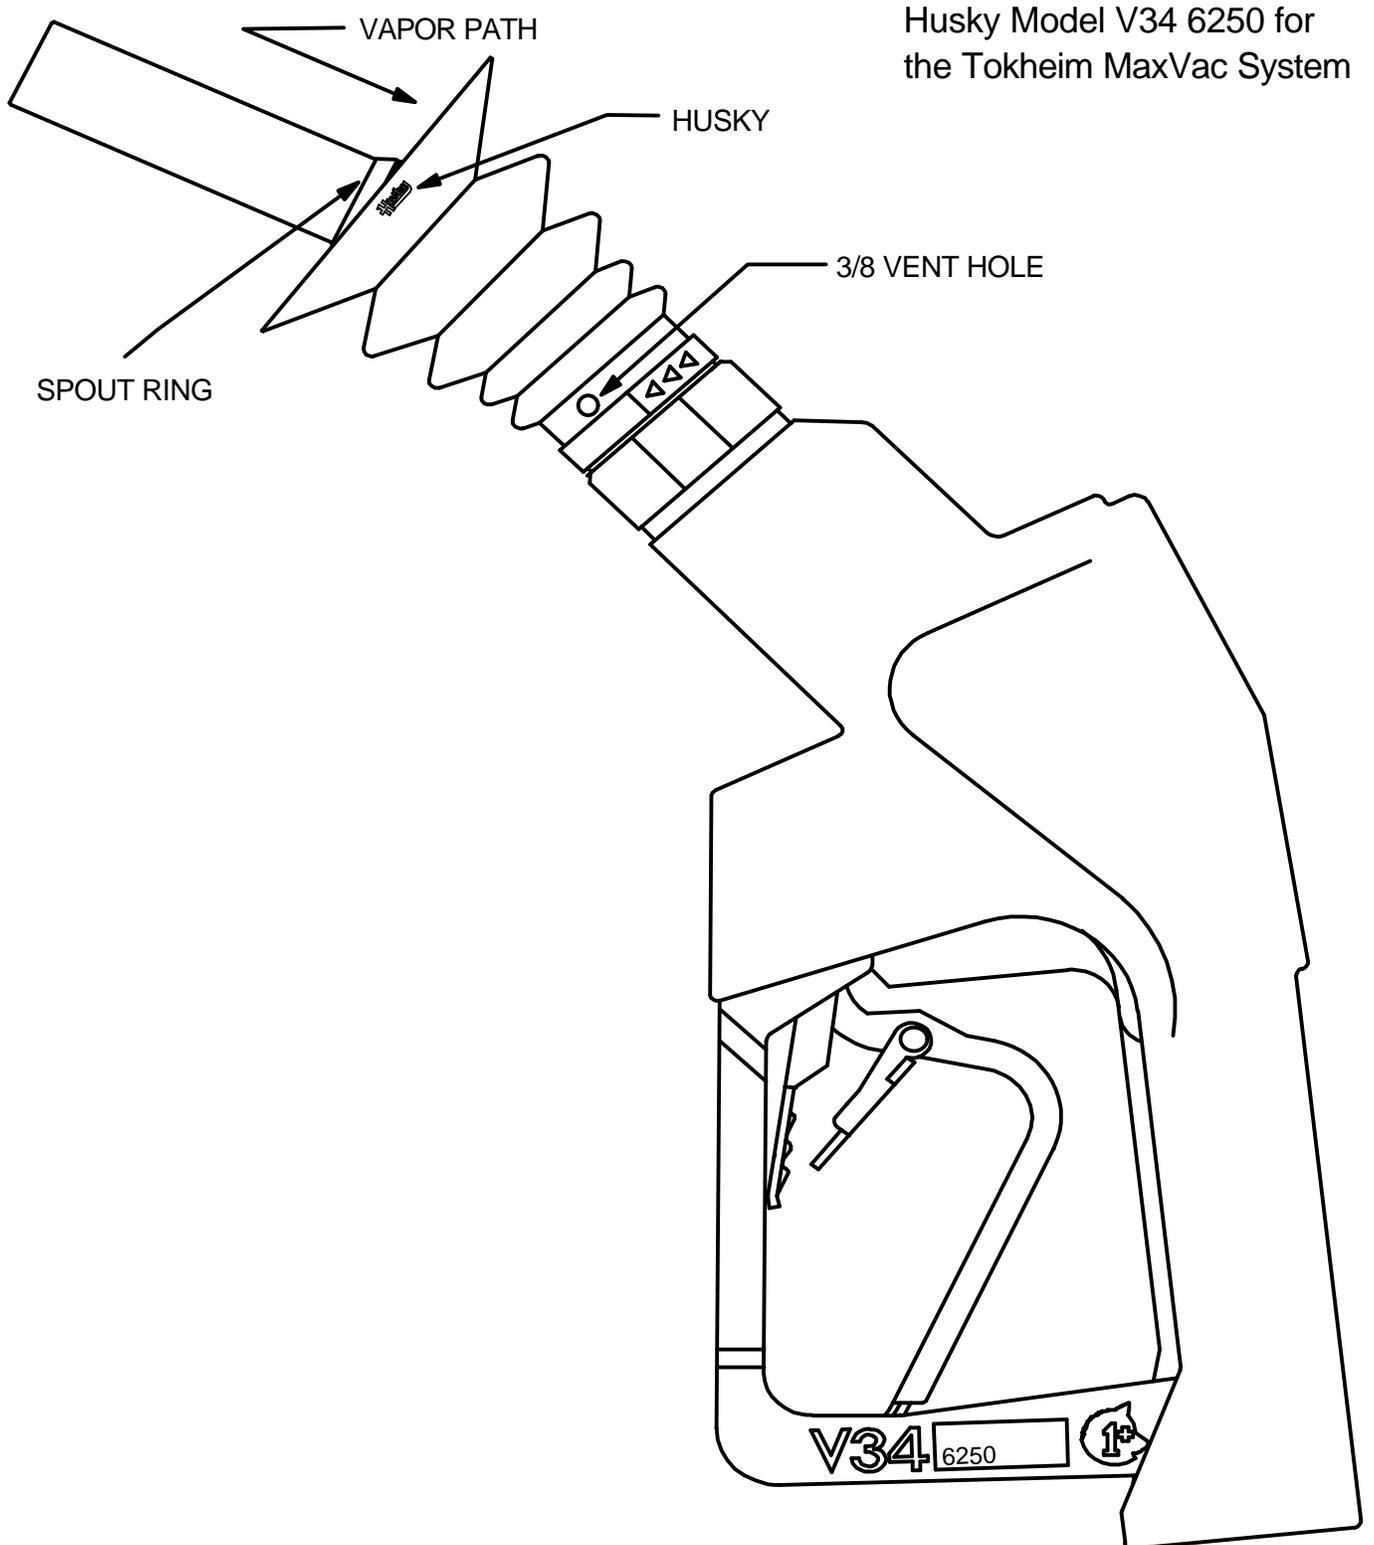


# Executive Order G-70-154-AA

## Exhibit 2

### Figure 2D-5

Emco Wheaton A4505 for  
the Tokheim MaxVac System

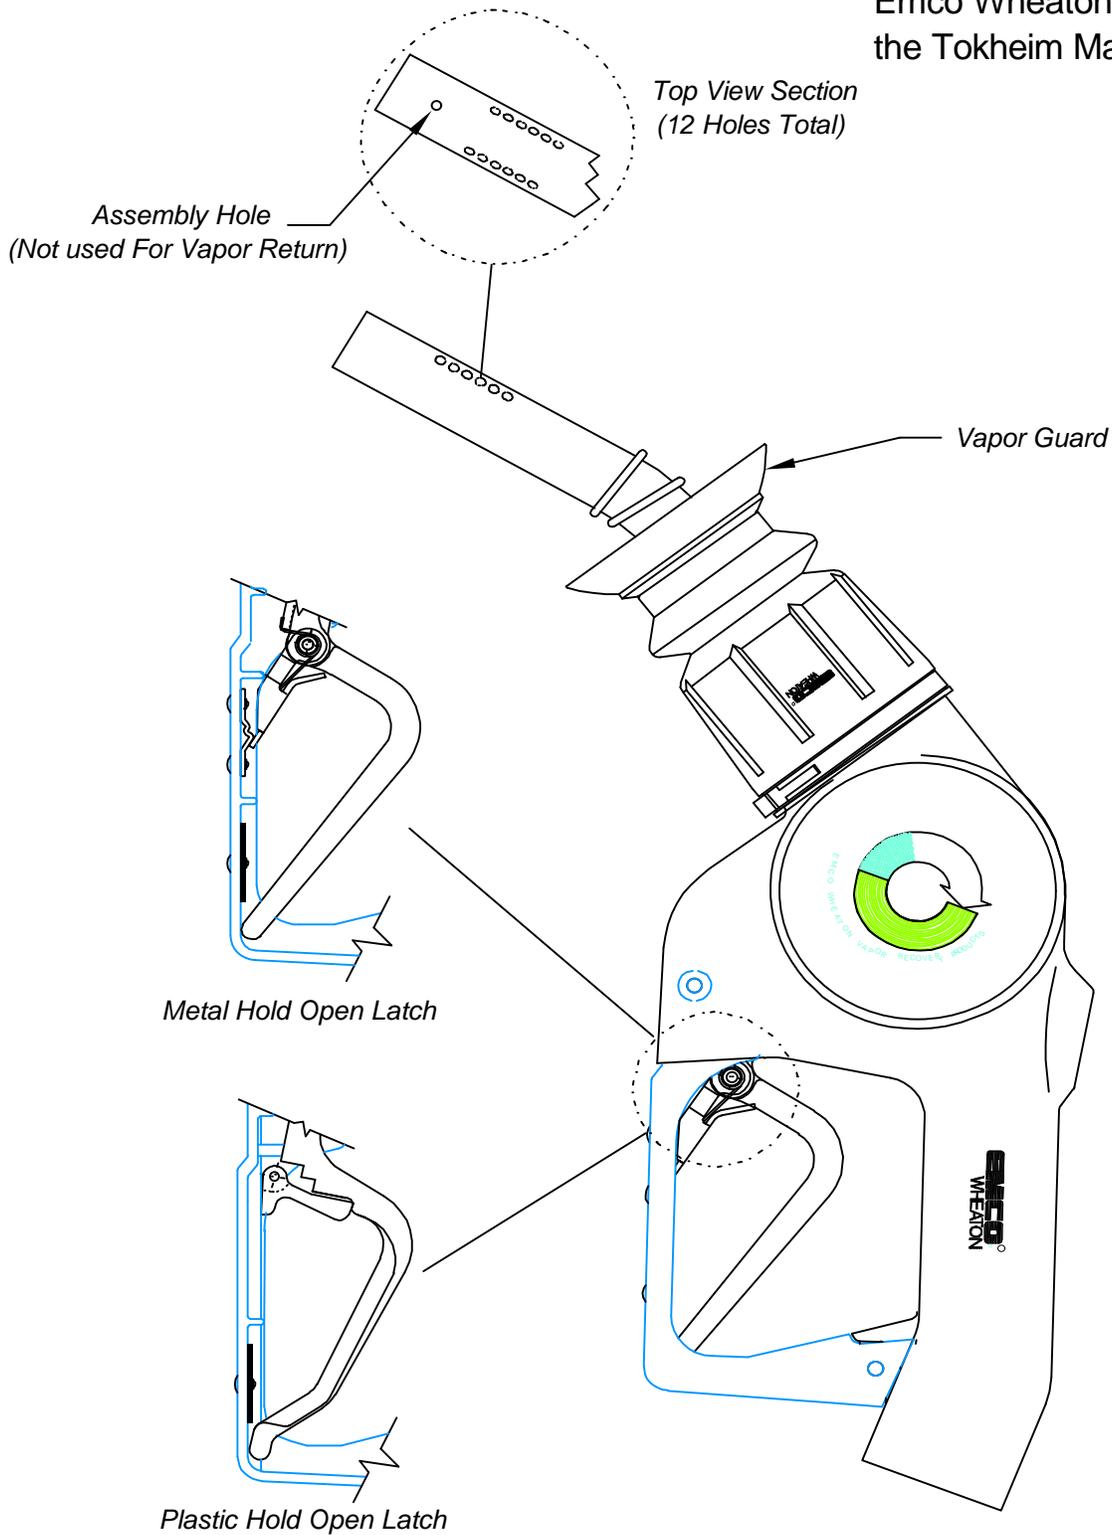


**Executive Order G-70-154-AA**

**Exhibit 2**

**Figure 2D-6**

Catlow ICVN Nozzle for  
the Tokheim MaxVac System

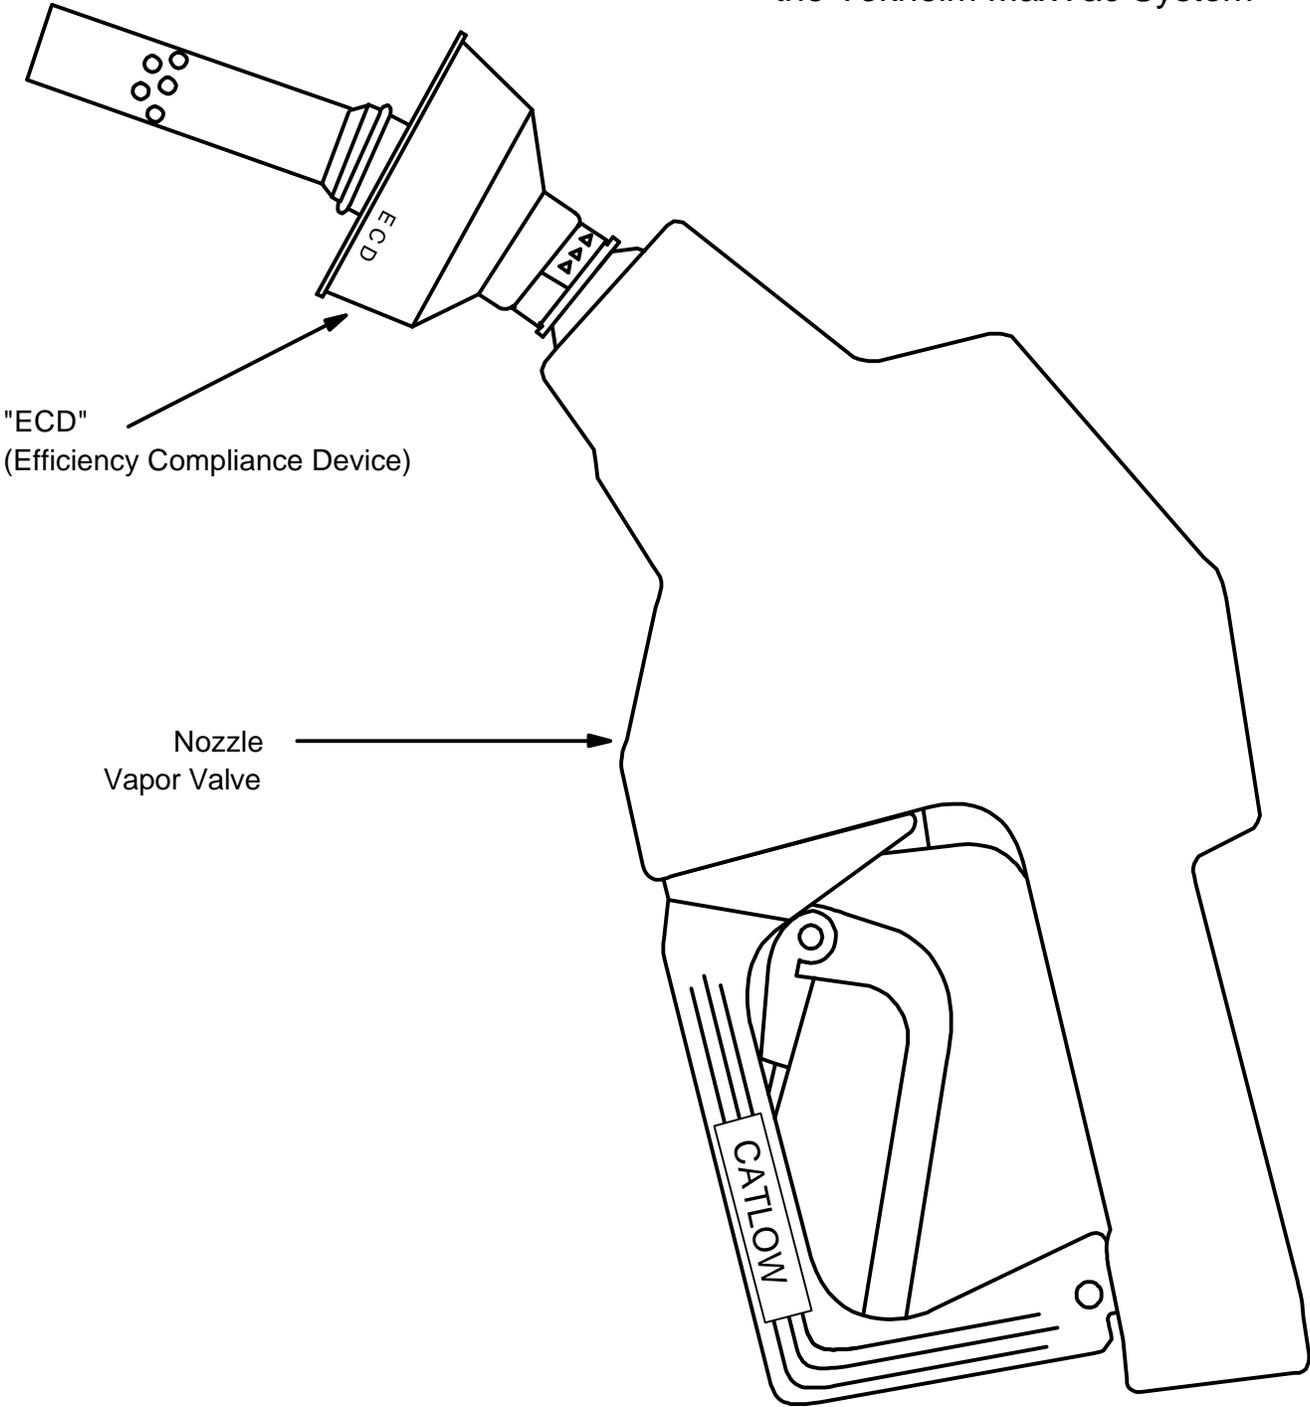


**Executive Order G-70-154-AA**

**Exhibit 2**

**Figure 2D-7**

Richards Astrovac Nozzle for  
the Tokheim MaxVac System

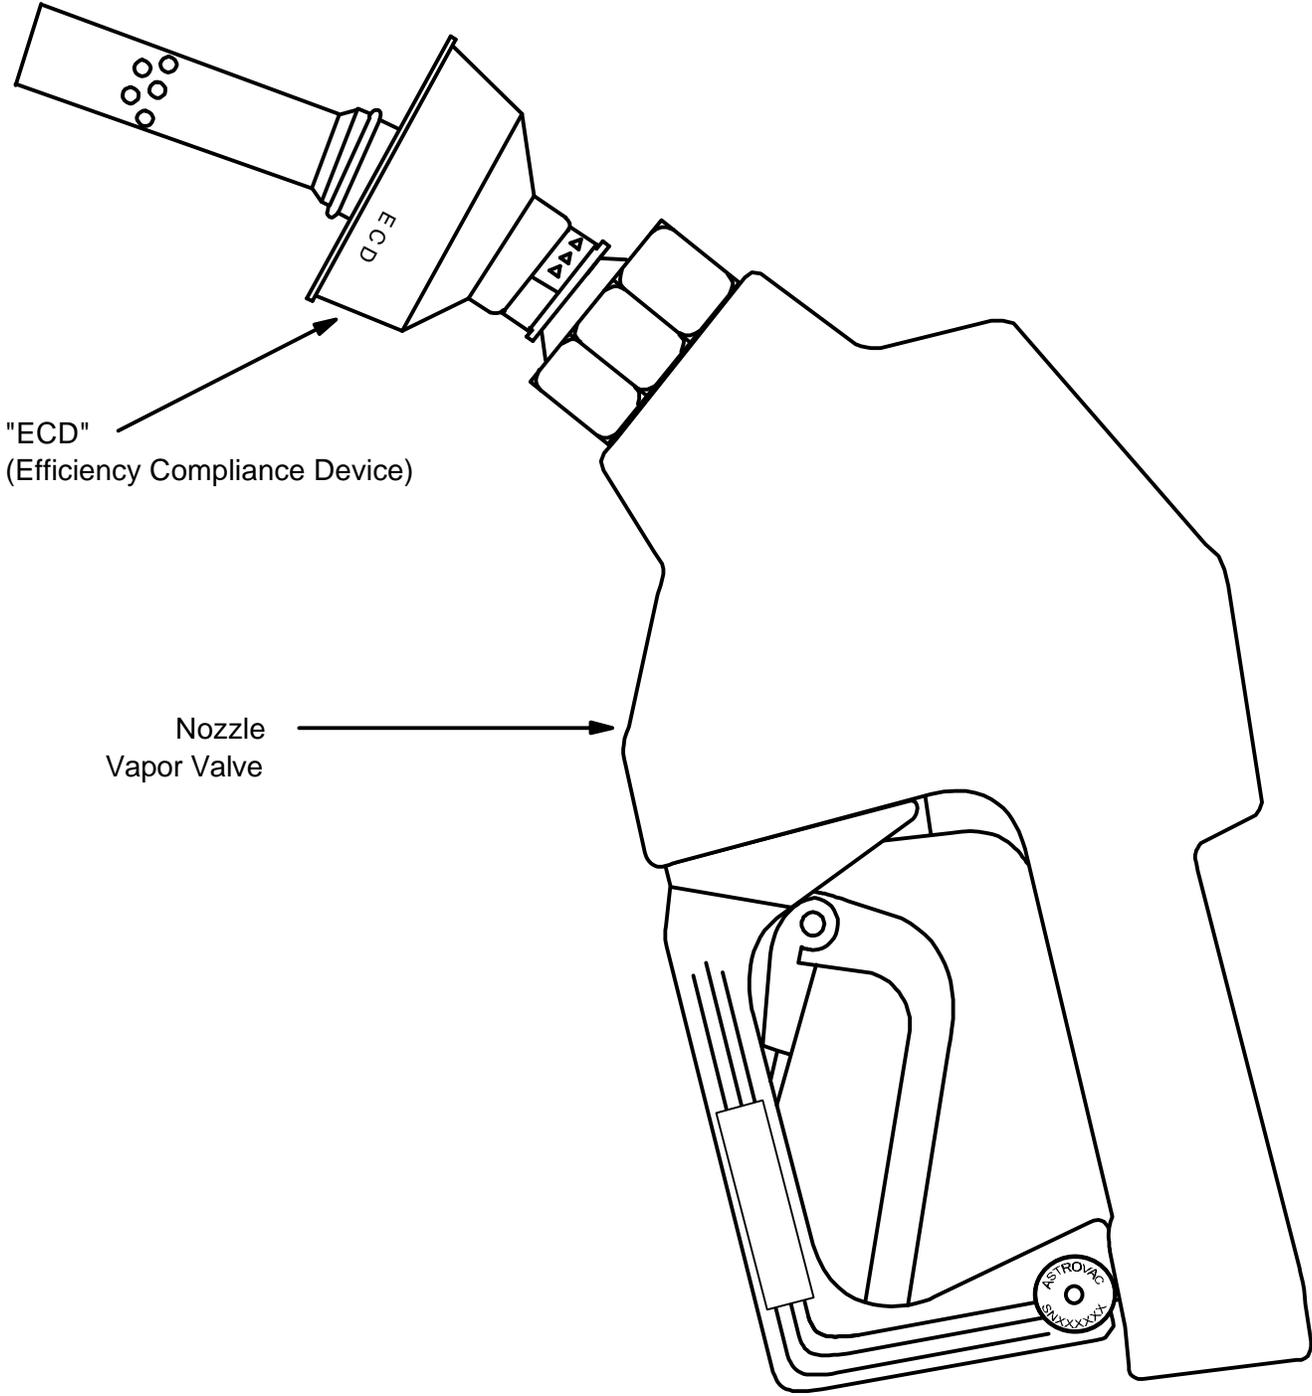


"ECD"  
(Efficiency Compliance Device)

Nozzle  
Vapor Valve

# Executive Order G-70-154-AA

## Exhibit 2

### Figure 2E

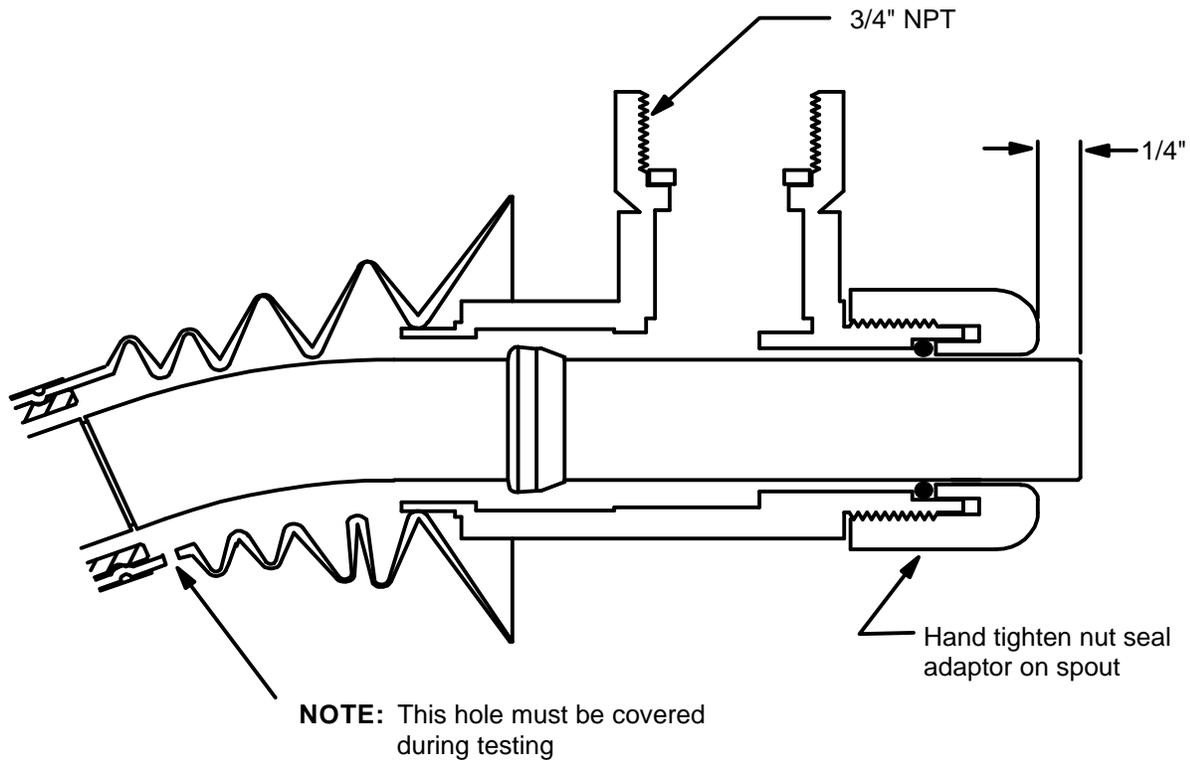

### Instructions for use of the 6250 A/L Adaptor

- 1) Inspect the Vapor Splash Guard (VSG) and spout for damage. Any tears or extra holes in the VSG will reduce the accuracy of the test.
- 2) Slide the A/L adaptor over the spout such that 1/4" of the spout is exposed past the nut.
- 3) Hand tighten the nut. This will seal the A/L adaptor to the spout.
- 4) Pull the VSG up over the smallest step on the A/L adaptor. This will seal the VSG to the adaptor.
- 5) Using a piece of tape, seal the 1/8" hole in the cuff of the VSG.


**Executive Order G-70-154-AA**

**Exhibit 2**


**Figure 2F**

**Installation of the A/L Adaptor**

**Exclude Shut-off Port:** Note that the o-ring has isolated the shut-off port from the vapor holes

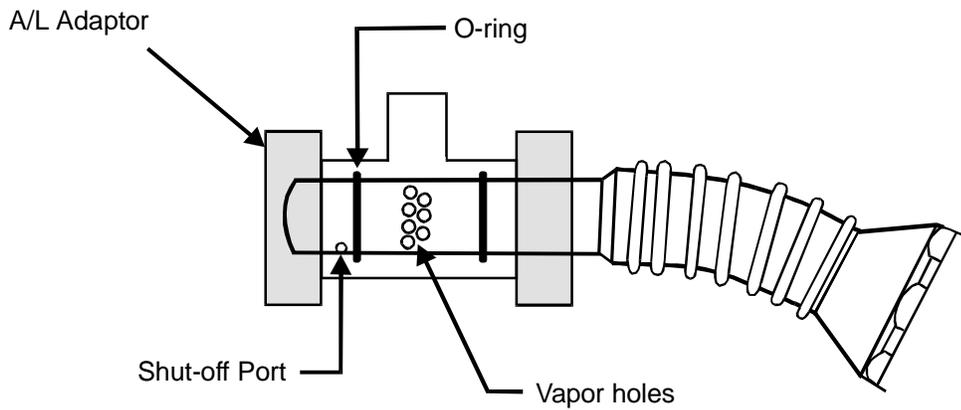

**Include Shut-off Port:** Note that the o-ring includes the shut-off port with the vapor holes

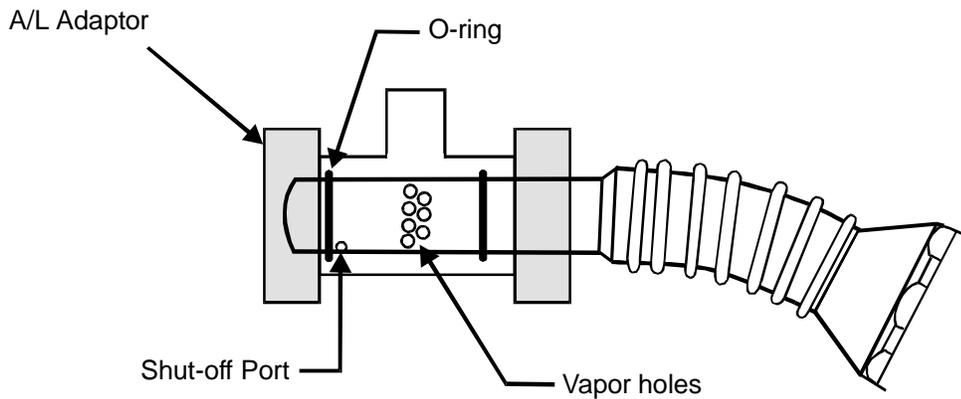

# Executive Order G-70-154-AA

## Tokheim MaxVac Phase II Vapor Recovery System

### Exhibit 3

## STATIC PRESSURE INTEGRITY TEST UNDERGROUND STORAGE TANKS

### 1. APPLICABILITY

- 1.1 This test procedure is used to quantify the vapor tightness of vapor recovery systems installed at gasoline dispensing facilities (GDF) equipped with vacuum assist systems which require pressure/vacuum (P/V) valves, provided that the designed pressure setting of the P/V valves is a minimum of 2.5 inches of water column (inches H<sub>2</sub>O). Excessive leaks in the vapor recovery system will increase the quantity of fugitive hydrocarbon emissions and lower the overall efficiencies of both the Phase I and Phase II vapor recovery systems.
- 1.2 Systems equipped with a P/V valve(s) allowed to have a designed cracking pressure less than 2.5 inches H<sub>2</sub>O shall be bagged to eliminate any flow contribution through the valve assembly from the test results. The valve/vent pipe connection, however, shall remain unobstructed during this test.

### 2. PRINCIPLE

- 2.1 The entire vapor recovery system is pressurized with nitrogen to two (2.0) inches H<sub>2</sub>O. The system pressure is then allowed to decay and the pressure after five (5) minutes is compared with an allowable value. The minimum allowable five-minute final pressure is based on the system ullage and pressure decay equations. For the purpose of compliance determination, this test shall be conducted after all back-filling, paving and installation of all Phase I and Phase II components, including P/V valves, has been completed.
- 2.2 For GDF equipped with a coaxial Phase I system, this test shall be conducted at a Phase II vapor riser. For GDF which utilize a two-point Phase I system, this test may be conducted at either a Phase II riser or a Phase I vapor coupler provided that the criteria set forth in Section 6.7 have been met. If the integrity criteria for two-point systems specified in Section 6.7 are met, it is recommended that this test be conducted at the Phase I vapor coupler.

### 3. RANGE

- 3.1 If mechanical pressure gauges are employed, the full-scale range of the pressure gauges shall be 0-2.0, 0-1.0, and 0-0.50 inches H<sub>2</sub>O column. Maximum incremental graduations of the pressure gauge shall be 0.05 inches H<sub>2</sub>O and the minimum accuracy of the gauge shall be three percent of full scale. The minimum diameter of the pressure gauge face shall be 4 inches. A 0-2 inches H<sub>2</sub>O inclined manometer, or equivalent, may be used provided that the minor scale divisions do not exceed 0.02 inches H<sub>2</sub>O.


- 3.2 If an electronic pressure measuring device is used, the full-scale range of the device shall not exceed 0-10 inches H<sub>2</sub>O with a minimum accuracy of 0.5 percent of full-scale. A 0-20 inches H<sub>2</sub>O device may be used, provided the equivalent accuracy is not less than 0.25 percent of full scale.
- 3.3 The minimum and maximum total ullages shall be 500 and 25,000 gallons, respectively. These values are exclusive of all vapor piping volumes.
- 3.4 The minimum and maximum nitrogen feed-rates, into the system, shall be one (1) and five (5) CFM, respectively.

4. INTERFERENCES

- 4.1 Introduction of nitrogen into the system at flowrates exceeding five (5) CFM may bias the results of the test toward non-compliance. Only gaseous nitrogen shall be used to conduct this test. Air, liquefied nitrogen, helium, or any gas other than nitrogen **shall not be used** for this test procedure.
- 4.2 The results of this Static Pressure Integrity Test shall not be used to verify compliance if an Air to Liquid Volumetric Ratio Test (Test Procedure TP -201.5 or equivalent) was conducted within the 24 hours prior to this test.

Figure 3-1

"T" Connector Assembly

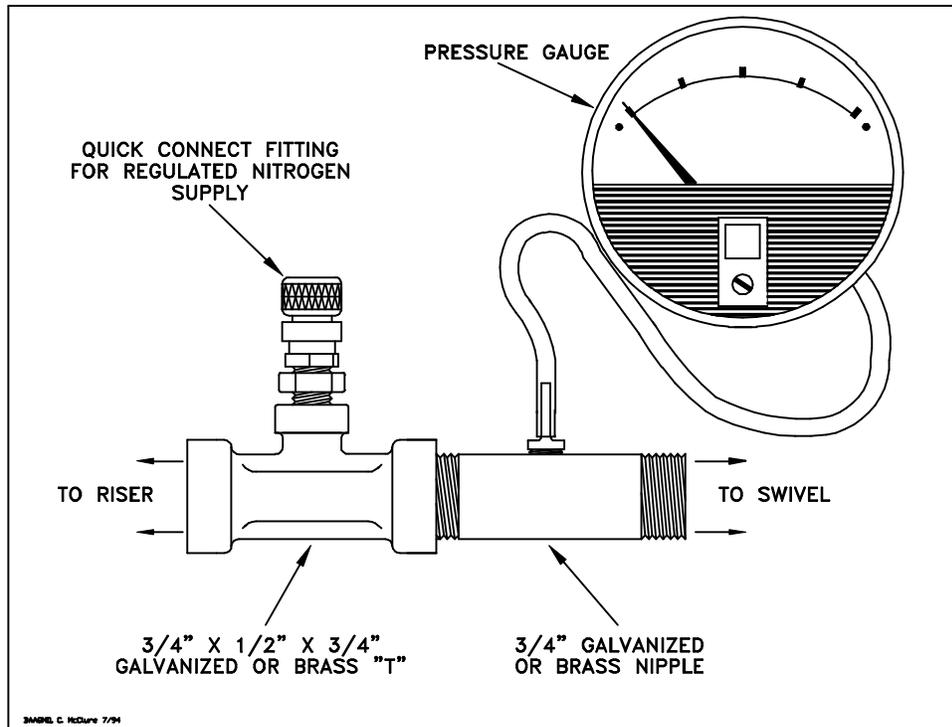


## 5. APPARATUS

- 5.1 Nitrogen. Use commercial grade nitrogen in a high pressure cylinder, equipped with a two-stage pressure regulator and a one psig pressure relief valve.
- 5.2 Pressure Measuring Device. Use 0-2.0, 0-1.0, and 0-0.50 inches H<sub>2</sub>O pressure gauges connected in parallel, a 0-2 inches H<sub>2</sub>O manometer, or an electronic pressure measuring device to monitor the pressure decay in the vapor recovery system. The pressure measuring device shall, at a minimum, be readable to the nearest 0.05 inches H<sub>2</sub>O.
- 5.3 "T" Connector Assembly. See Figure 3-1 for example.
- 5.4 Vapor Coupler Integrity Assembly. Assemble OPW 633-A, 633-B, and 634-A adapters, or equivalent, as shown in Figure 3-2. If the test is to be conducted at the storage tank Phase I vapor coupler, this assembly shall be used prior to conducting the static leak test in order to verify the pressure integrity of the vapor poppet. The internal volume of this assembly shall not exceed 0.1 cubic feet.


Figure 3-2

### Vapor Coupler Integrity Assembly

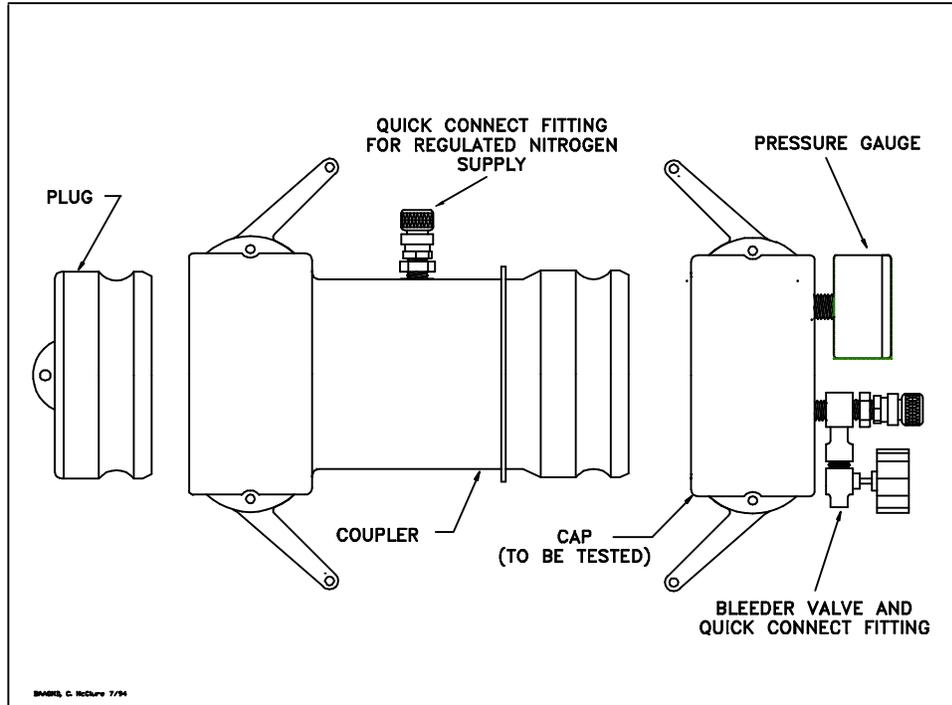

- 5.5** Vapor Coupler Test Assembly. Use a compatible OPW 634-B cap, or equivalent, equipped with a center probe to open the poppet, a pressure measuring device to monitor the pressure decay, and a connection for the introduction of nitrogen into the system. See Figure 3-3 for an example .

**Figure 3-3**  
**Vapor Coupler Integrity Assembly**

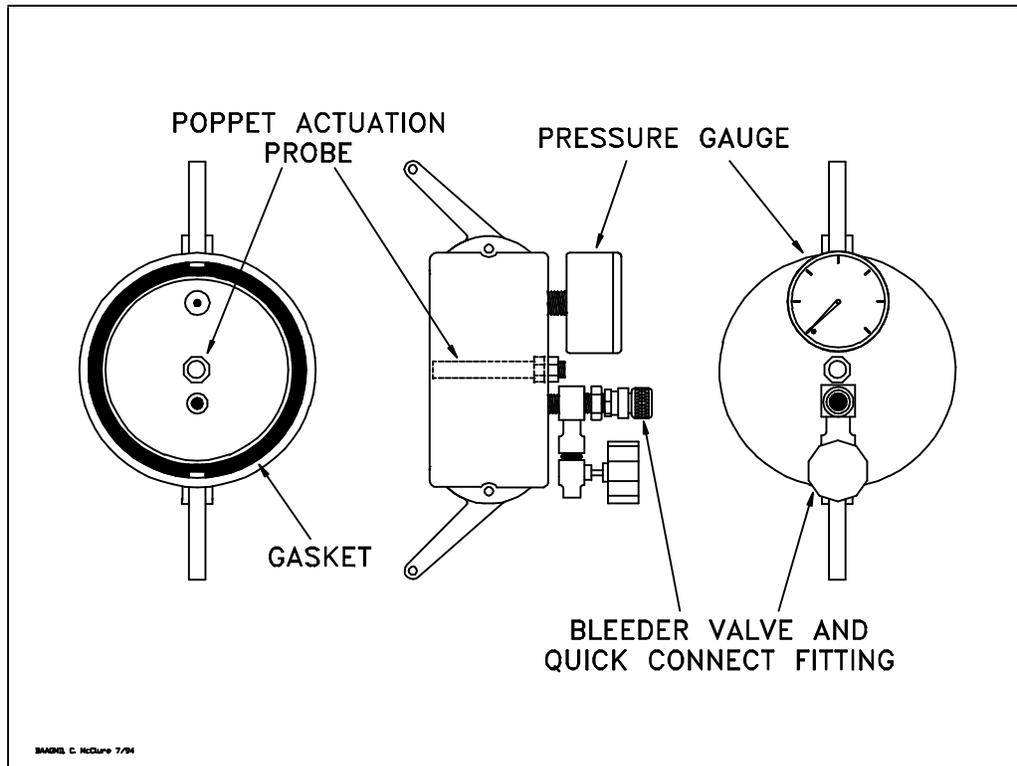

- 5.6** Stopwatch. Use a stopwatch accurate to within 0.2 seconds .
- 5.7** Flowmeter. Use a Dwyer flowmeter, Model RMC-104, or equivalent, to determine the required pressure setting of the delivery pressure gauge on the nitrogen supply pressure regulator. This pressure shall be set such that the nitrogen flowrate is between 1.0 and 5.0 CFM.
- 5.8** Combustible Gas Detector. A Bacharach Instrument Company, Model 0023-7356, or equivalent, may be used to verify the pressure integrity of system components during this test.
- 5.9** Leak Detection Solution. Any liquid solution designed to detect vapor leaks may be used to verify the pressure integrity of system components during this test.

## **6. PRE-TEST PROCEDURES**

- 6.1** The following safety precautions shall be followed:
  - 6.1.1** Only nitrogen shall be used to pressurize the system.
  - 6.1.2** A one psig relief valve shall be installed to prevent the possible over-pressurizing of the storage tank.
  - 6.1.3** A ground strap should be employed during the introduction of nitrogen into the system.
  
- 6.2** Failure to adhere to any or all of the following time and activity restrictions shall invalidate the test results:
  - 6.2.1** There shall be no Phase I bulk product deliveries into or out of the storage tank(s) within the three (3) hours prior to the test or during performance of this test procedure.
  - 6.2.2** There shall be no product dispensing within thirty (30) minutes prior to the test or during performance of this test procedure.
  - 6.2.3** Upon commencement of the thirty minute “no dispensing” portion of this procedure, the headspace pressure in the tank shall be measured. If the pressure exceeds 0.50 inches H<sub>2</sub>O, the pressure shall be carefully relieved in accordance with all applicable safety requirements. After the thirty minute “no dispensing” portion of this procedure, and prior to introduction of nitrogen, the headspace pressure shall again be lowered, if necessary, to less than 0.50 inches H<sub>2</sub>O.
  - 6.2.4** There shall be no Air to Liquid Volumetric Ratio Test (Test Procedure TP-201.5) conducted within the twenty-four (24) hour period immediately prior to this test.
  
- 6.3** Measure the gallons of gasoline present in each underground storage tank and determine the actual capacity of each storage tank from facility records. Calculate the ullage space for each tank by subtracting the gasoline gallonage present from the actual tank capacity. The minimum ullage during the test shall be 25 percent of the tank capacity or 500 gallons, whichever is greater. The total ullage shall not exceed 25,000 gallons.
  
- 6.4** For two-point Phase I systems, this test shall be conducted with the dust cap removed from the vapor coupler. This is necessary to determine the vapor tightness of the Phase I vapor poppet. See Section 6.7 if this test is to be conducted at the Phase I vapor coupler.
  - 6.4.1** For coaxial Phase I systems, this test shall be conducted with the dust cap removed from the Phase I coupler. This is necessary to insure the vapor tightness of the Phase I vapor poppet.
  - 6.4.2** Verify that the liquid level in the storage tank is at least four (4) inches above the highest opening at the bottom of the submerged drop tube.

- 6.5** If the Phase I containment box is equipped with a drain valve, the valve assembly may be cleaned and lubricated prior to the test. This test shall, however, be conducted with the drain valve installed and the manhole cover removed. See subsection 7.4.1 for further details regarding containment box drain valves.
- 6.6** If the test is to be conducted at a Phase II vapor riser, disconnect the dispenser end of one vapor recovery hose and install the "T" connector assembly (see Figure 3-1). Connect the nitrogen gas supply (do not use air) and the pressure measuring device to the "T" connector.
- 6.6.1** For those Phase II systems utilizing a dispenser mounted remote vapor check valve, the "T" connector assembly shall be installed on the vapor riser side of the check valve.
- 6.7** If this test is to be conducted at the Phase I vapor coupler on a two-point Phase I system, the procedures set forth in subsections 6.7.1 and 6.7.2 shall be successfully completed prior to testing. The static pressure integrity test shall not be conducted at the Phase I coupler at facilities equipped with coaxial Phase I systems.
- 6.7.1** Connect the Vapor Coupler Integrity Assembly to the Phase I vapor coupler. Connect the Vapor Coupler Test Assembly. Connect the nitrogen supply to the assembly and carefully pressurize the internal volume of the assembly to two (2.0) inches H<sub>2</sub>O. Start the stopwatch. Record the final pressure after one minute.
- 6.7.2** If the pressure after one minute is less than 0.25 inches H<sub>2</sub>O, the leak rate through the Phase I vapor poppet precludes conducting the static leak test at this location. If the pressure after one minute is greater than or equal to 0.25 inches H<sub>2</sub>O, the static leak test may be conducted at this location. This criteria assures a maximum leak rate through the Phase I vapor poppet of less than 0.0004 cubic feet per minute.
- 6.7.3** Disconnect the Vapor Coupler Integrity Assembly from the Phase I vapor coupler. If the requirements of subsection 6.7.2 were met, connect the Vapor Coupler Test Assembly to the Phase I vapor coupler.
- 6.7.4** As an alternate to the requirements of subsections 6.7.1 through 6.7.3, leak detection solution may be used to verify the absence of vapor leaks through the Phase I vapor poppet on two-point Phase I systems. This alternative leak check is valid only for two-point Phase I systems in which tanks are manifolded. The manifold may be at the vent pipes. Pressurize the system to two (2) inches H<sub>2</sub>O and use the leak detection solution to verify a zero leak (absence of bubbles) condition at one of the vapor poppets on the Phase I system.
- 6.8** All pressure measuring device(s) shall be bench calibrated using either a reference gauge or incline manometer. Calibration shall be performed at 20, 50, and 80 percent of full scale. Accuracy shall be within two percent at each

of these calibration points. Calibrations shall be conducted on a frequency not to exceed 90 days.

- 6.9** Use the flowmeter to determine the nitrogen regulator delivery pressures which correspond to nitrogen flowrates of 1.0 and 5.0 CFM. These pressures define the allowable range of delivery pressures acceptable for this test procedure. Also record which regulator delivery pressure setting, and the corresponding nitrogen flowrate that will be used during the test. As an alternative, the flowmeter may be connected, in-line between the nitrogen supply regulator and Vapor Coupler Test Assembly, during the test.
- 6.10** Use Equation 9.2 to calculate the approximate time required to pressurize the system ullage to the initial starting pressure of two (2.0) inches H<sub>2</sub>O. This will allow the tester to minimize the quantity of nitrogen introduced into those systems which cannot comply with the static leak standards.
- 6.11** Attach the Vapor Coupler Test assembly to the Phase I poppet or the "T" connector assembly to the Phase II vapor riser. Read the initial pressure of the storage tank and underground piping. If the initial pressure is greater than 0.5 inches H<sub>2</sub>O, carefully bleed off the pressure, in accordance with all applicable safety procedures, in the storage tank and underground piping to less than 0.5 inches H<sub>2</sub>O column.

## **7. TESTING**

- 7.1** Open the nitrogen gas supply valve and set the regulator delivery pressure within the allowable range determined in Section 6.9, and start the stopwatch. Pressurize the vapor system (or subsystem for individual vapor return line systems) to **at least 2.2 inches H<sub>2</sub>O** initial pressure. It is critical to maintain the nitrogen flow until the pressure stabilizes, indicating temperature and vapor pressure stabilization in the tanks. Check the test equipment using leak detecting solution or a combustible gas detector to verify that all test equipment is leak tight.
  - 7.1.1** If the time required to achieve the initial pressure of two (2.00) inches H<sub>2</sub>O exceeds twice the time derived from Equation 9.2, stop the test and use a liquid leak detector, or a combustible gas detector, to find the leak(s) in the system. Failure to achieve the initial starting pressure within twice the time derived from Equation 9.2 demonstrates the inability of the system to meet the performance criteria. Repair or replace the faulty component(s) and restart the test pursuant to Section 7.1.
- 7.2** Close and disconnect the nitrogen supply. Start the stopwatch when the pressure has decreased to the initial starting pressure of two (2.0) inches H<sub>2</sub>O.
- 7.3** At one-minute intervals during the test, record the system pressure. After five minutes, record the final system pressure. See Table 3-I (or Equation 9.1) to determine the acceptability of the final system static pressure results. For intermediate values of ullage in Tables 3-I, linear interpolation may be employed.

- 7.4** If the system failed to meet the criteria set forth in Table 3-I (or Equation 9-2), repressurize the system and check all accessible vapor connections using leak detector solution or a combustible gas detector. If vapor leaks in the system are encountered, repair or replace the defective component and repeat the test. Potential sources of leaks include nozzle check valves, pressure/vacuum relief valves, containment box drain valve assemblies, and plumbing connections at the risers.
- 7.4.1** If the facility fails to comply with the static leak test standards and the Phase I system utilizes a non-CARB-certified drain valve equipped containment box, which was installed prior to July 1, 1992, for which a CARB-certified replacement drain valve assembly is not marketed, the following two subsections shall apply:
- 7.4.1.1** The drain valve may be removed and the port plugged. Reset the system. If the facility complies with the static leak test standards under these conditions, the facility shall be considered complying with the requirements, provided that the manufacturer and model number of the containment box and the date of installation are submitted with the test results.
- 7.4.1.2** The criteria set forth in subsection 7.4.1.1 shall not apply after July 1, 1996.
- 7.5** After the remaining system pressure has been relieved, remove the "T" connector assembly and reconnect the vapor recovery hose, if applicable.
- 7.6** If the vapor recovery system utilizes individual vapor return lines, repeat the leak test for each gasoline grade. Avoid leaving any vapor return line open longer than is necessary to install or remove the "T" connector assembly.
- 7.7** If the containment box has a cover-actuated drain valve, repeat the test with the cover in place. In these cases clearly specify, on Form 3-1, which results represent the pressure integrity with and without the cover in place.

## **8. POST-TEST PROCEDURES**

- 8.1** Use Table 3-I, or Equation 9.1 to determine the compliance status of the facility by comparing the final five-minute pressure with the minimum allowable final pressure.

## 9. CALCULATIONS

- 9.1 The minimum allowable five-minute final pressure, with an initial pressure of two (2.0) inches H<sub>2</sub>O, shall be calculated as follows:

[Equation 9-1]

$$P_f = 2e^{\frac{-500.887}{V}} \quad \text{if } N = 1-6$$

$$P_f = 2e^{\frac{-531.614}{V}} \quad \text{if } N = 7-12$$

$$P_f = 2e^{\frac{-562.455}{V}} \quad \text{if } N = 13-18$$

$$P_f = 2e^{\frac{-593.412}{V}} \quad \text{if } N = 19-24$$

$$P_f = 2e^{\frac{-624.483}{V}} \quad \text{if } N > 24$$

Where:

- N = The number of affected nozzles. For manifolded systems, N equals the total number of nozzles. For dedicated plumbing configurations, N equals the number of nozzles serviced by the tank being tested.
- V = The total ullage affected by the test, gallons
- P<sub>f</sub> = The minimum allowable five-minute final pressure, inches H<sub>2</sub>O
- e = A dimensionless constant approximately equal to 2.718
- 2 = The initial starting pressure, inches H<sub>2</sub>O

- 9.2 The minimum time required to pressure the system ullage from zero (0) to two (2.0) inches H<sub>2</sub>O gauge pressure shall be calculated as follows:

$$t_2 = \frac{V}{[1522]F} \quad \text{[Equation 9-2]}$$

Where:

- t<sub>2</sub> = The minimum time to pressurize the ullage to two inches H<sub>2</sub>O, minutes
- V = The total ullage affected by the test, gallons
- F = The nitrogen flowrate into the system, CFM
- 1522 = The conversion factor for pressure and gallons

- 9.3** If the policy of the local district requires an allowable tolerance for testing error, the minimum allowable five-minute final pressure, including testing error, shall be calculated as follows:

$$P_{f-E} = 2 - \left[ 1 + \left( \frac{E}{100} \right) \right] [408.9 - (P_f + 406.9)] \quad \text{[Equation 9-3]}$$

Where:

- $P_{f-E}$  = The minimum allowable five-minute final pressure including allowable testing error, inches H<sub>2</sub>O
- $E$  = The allowable testing error, percent
- $P_f$  = The minimum allowable five-minute final pressure calculated in Equations 9-1 or 9-2, inches H<sub>2</sub>O
- $2$  = The initial starting pressure, inches H<sub>2</sub>O
- $408.9$  = Atmospheric pressure plus the initial starting pressure, inches H<sub>2</sub>O
- $406.9$  = Atmospheric pressure, inches H<sub>2</sub>O

## 10. REPORTING

- 10.1** The calculated ullage and system pressures for each five-minute vapor recovery system test shall be reported as shown in Form 3-1. Be sure to include the Phase I system type (two-point or coaxial), the Phase II system type, whether the system is manifolded, and the one-minute pressures during the test.

Executive Order G-70-154-AA

TABLE 3-1

Pressure Decay Leak Rate Criteria  
 Initial Pressure of 2 inches of H<sub>2</sub>O  
 Minimum Pressure After 5 Minutes, inches of H<sub>2</sub>O

ULLAGE, GALLONS	NUMBER OF AFFECTED NOZZLES				
	01-06	07-12	13-18	19-24	> 24
<b>500</b>	<b>0.73</b>	<b>0.69</b>	<b>0.65</b>	<b>0.61</b>	<b>0.57</b>
550	0.80	0.76	0.72	0.68	0.64
<b>600</b>	<b>0.87</b>	<b>0.82</b>	<b>0.78</b>	<b>0.74</b>	<b>0.71</b>
650	0.93	0.88	0.84	0.80	0.77
<b>700</b>	<b>0.98</b>	<b>0.94</b>	<b>0.90</b>	<b>0.86</b>	<b>0.82</b>
750	1.03	0.98	0.94	0.91	0.87
<b>800</b>	<b>1.07</b>	<b>1.03</b>	<b>0.99</b>	<b>0.95</b>	<b>0.92</b>
850	1.11	1.07	1.03	1.00	0.96
<b>900</b>	<b>1.15</b>	<b>1.11</b>	<b>1.07</b>	<b>1.03</b>	<b>1.00</b>
950	1.18	1.14	1.11	1.07	1.04
<b>1,000</b>	<b>1.21</b>	<b>1.18</b>	<b>1.14</b>	<b>1.10</b>	<b>1.07</b>
1,200	1.32	1.28	1.25	1.22	1.19
<b>1,400</b>	<b>1.40</b>	<b>1.37</b>	<b>1.34</b>	<b>1.31</b>	<b>1.28</b>
1,600	1.46	1.43	1.41	1.38	1.35
<b>1,800</b>	<b>1.51</b>	<b>1.49</b>	<b>1.46</b>	<b>1.44</b>	<b>1.41</b>
2,000	1.56	1.53	1.51	1.49	1.46
<b>2,200</b>	<b>1.59</b>	<b>1.57</b>	<b>1.55</b>	<b>1.53</b>	<b>1.51</b>
2,400	1.62	1.60	1.58	1.56	1.54
<b>2,600</b>	<b>1.65</b>	<b>1.63</b>	<b>1.61</b>	<b>1.59</b>	<b>1.57</b>
2,800	1.67	1.65	1.64	1.62	1.60
<b>3,000</b>	<b>1.69</b>	<b>1.68</b>	<b>1.66</b>	<b>1.64</b>	<b>1.62</b>
3,500	1.73	1.72	1.70	1.69	1.67
<b>4,000</b>	<b>1.76</b>	<b>1.75</b>	<b>1.74</b>	<b>1.72</b>	<b>1.71</b>
4,500	1.79	1.78	1.77	1.75	1.74
<b>5,000</b>	<b>1.81</b>	<b>1.80</b>	<b>1.79</b>	<b>1.78</b>	<b>1.77</b>
6,000	1.84	1.83	1.82	1.81	1.80
<b>7,000</b>	<b>1.86</b>	<b>1.85</b>	<b>1.85</b>	<b>1.84</b>	<b>1.83</b>
8,000	1.88	1.87	1.86	1.86	1.85
<b>9,000</b>	<b>1.89</b>	<b>1.89</b>	<b>1.88</b>	<b>1.87</b>	<b>1.87</b>
10,000	1.90	1.90	1.89	1.88	1.88
<b>15,000</b>	<b>1.93</b>	<b>1.93</b>	<b>1.93</b>	<b>1.92</b>	<b>1.92</b>
20,000	1.95	1.95	1.94	1.94	1.94
<b>25,000</b>	<b>1.96</b>	<b>1.96</b>	<b>1.96</b>	<b>1.95</b>	<b>1.95</b>

**Note:** For manifolded Phase II Systems, the "Number of Affected Nozzles" shall be the total of all gasoline nozzles. For dedicated return configurations, the "Number of Affected Nozzles" shall be the total of those nozzles served by the tank being tested.

## Form 3-1

<b>Distribution:</b>	<b>Executive Order G-70-154-AA Exhibit 3</b>	<b>Report No.:</b> _____ <b>Test Date:</b> _____ <b>Test Times:</b> <b>Run A:</b> _____ <b>Run B:</b> _____ <b>Run C:</b> _____
<b>Summary of Source Test Results</b>		

Source Information		Facility Parameters	
<b>GDF Name and Address</b> _____ _____ _____	<b>GDF Representative and Title</b> _____ _____ <b>GDF Phone No. (    )</b> _____ <b>Source: GDF Vapor Recovery System</b>	<b>PHASE I SYSTEM TYPE ( Check One)</b> <b>Two Point</b> <input type="checkbox"/> <b>Coaxial</b> <input type="checkbox"/> <b>Coaxial with Spill Prevention</b> <input type="checkbox"/>	
<b>Permit Conditions</b> _____	<b>GDF #</b> _____ <b>A/C #</b> _____	<b>PHASE II SYSTEM TYPE</b> <input type="checkbox"/> <b>Max Vac</b> <b>Manifolded?    Y    or    N</b>	
<b>Operating Parameters:</b> Number of Nozzles Served by Tank #1 _____      Number of Nozzles Served by Tank #3 _____ Number of Nozzles Served by Tank #2 _____      Total Number of Gas Nozzles at Facility _____			
<b>Applicable Regulations:</b>		FOR OFFICE USE ONLY:	

**Source Test Results and Comments:**

<b>TANK #:</b>	<b>1</b>	<b>2</b>	<b>3</b>	<b>TOTAL</b>
1. Product Grade	_____	_____	_____	_____
2. Actual Tank Capacity, Gallons	_____	_____	_____	_____
3. Gasoline Volume, Gallons	_____	_____	_____	_____
4. Ullage, Gallons (#2 -#3)	_____	_____	_____	_____
5. Phase I System Type	_____	_____	_____	_____
6. Initial Test Pressure, Inches H <sub>2</sub> O (2.0)	_____	_____	_____	_____
7. Pressure After 1 Minute, Inches H <sub>2</sub> O	_____	_____	_____	_____
8. Pressure After 2 Minutes, Inches H <sub>2</sub> O	_____	_____	_____	_____
9. Pressure After 3 Minutes, Inches H <sub>2</sub> O	_____	_____	_____	_____
10. Pressure After 4 Minutes, Inches H <sub>2</sub> O	_____	_____	_____	_____
11. <b>Final Pressure After 5 Minutes, Inches H<sub>2</sub>O</b>	_____	_____	_____	_____
12. Allowable Final Pressure from Table 3-1	_____	_____	_____	_____
13. Test Status [ <b>Pass</b> or <b>Fail</b> ]	_____	_____	_____	_____

Test Conducted by: _____	Test Company Name _____ Address _____ City _____	Date and Time of Test: _____
--------------------------	---	------------------------------

# Executive Order G-70-154-AA

## Exhibit 4

### TEN GALLON PER MINUTE LIMITATION COMPLIANCE VERIFICATION PROCEDURE

Compliance with the 10 gallon per minute flowrate limitation shall be determined with the following methodology. It is recommended that the maximum dispensing rate through each nozzle/hose assembly be verified.

#### 1) The facility uses identical models of hoses, nozzles, and breakaways:

Check the nozzle closest to the submersible turbine pump (STP) for each gas grade, or STP, at the facility. With no other dispensing occurring which uses the same STP, dispense gas into a vehicle or approved container. Dispensing shall be conducted in the “hand-held, wide-open” mode. Using a stopwatch accurate to at least 0.2 seconds, begin timing the dispensing rate after at least one gallon has been dispensed. This one gallon buffer is necessary due to the “slow-start” nature of some dispensers. Determine the time required to dispense 2, 3, 4, or 5 gallons of gasoline. The facility shall be deemed in compliance with the 10 gallon per minute limitations if the elapsed time meets, or exceeds, the times shown in Table 1. If the dispensing rate exceeds the allowable limit, a CARB-certified flow limiting device shall be installed.

#### 2) The facility uses different models of hoses, nozzles, or breakaways

Due to potential differences in pressure drops through the various components, each of the nozzle/hose assemblies shall be tested for maximum dispensing rates. Using the same criteria as above, determine the maximum dispensing rate through each nozzle/hose assembly. If the maximum dispensing rate exceeds the 10 gpm limit, a CARB-certified flow limiting device shall be installed.

**Table 1**  
**Verification of 10 gpm**

Product Dispensed, gallons	Minimum Allowable Time, seconds
2.0	11.8
3.0	17.7
4.0	23.6
5.0	29.5

**Note: The times have been corrected to allow for the accuracy of the measurement.**