


EXHIBIT 4
Executive Order G-70-52-AM

Dual Hose Side Mount High-Retractor Configuration
For Existing Installations Only

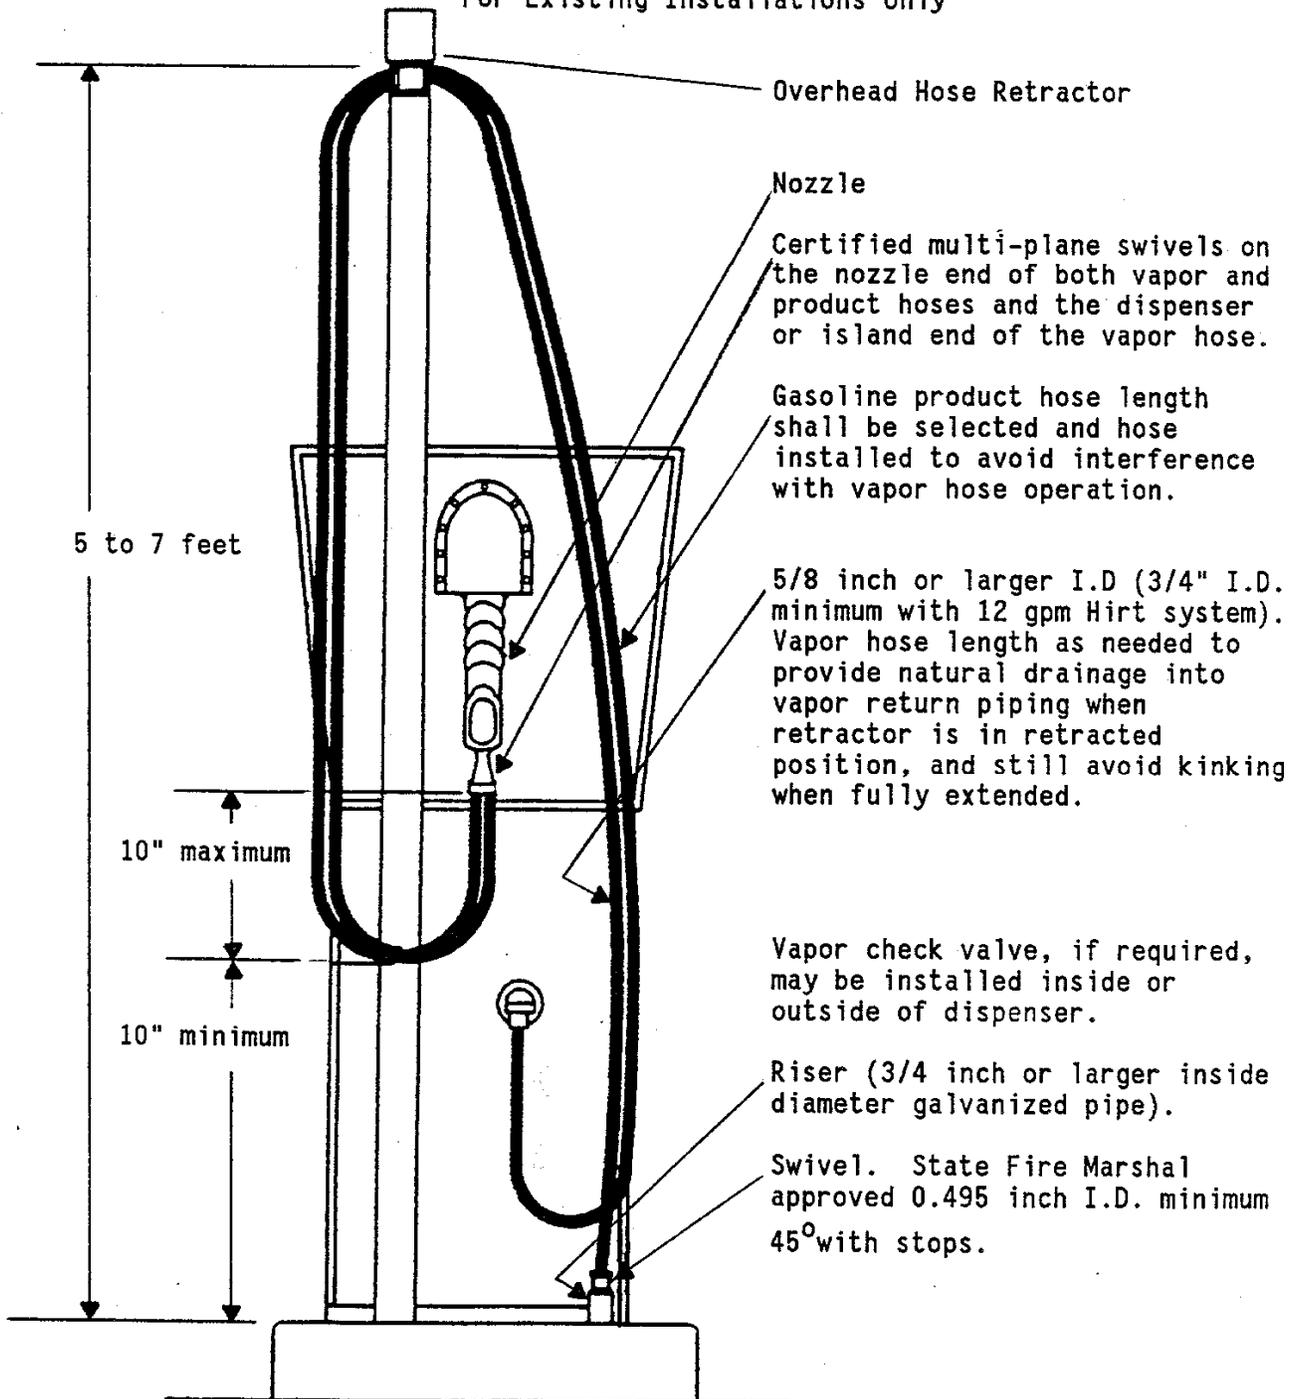

- Notes:
1. See Exhibit 2 for the component list.
 2. A flow limiter is required on dispensers that have a maximum flowrate in excess of 10 gpm. (A maximum flow rate of 12 gpm is permitted with the Hirt system provided vapor hoses are 3/4" ID.)
 3. Use appropriate hose ties.
 4. Vapor return piping may be installed on the inside or the outside of the dispenser cabinet.
 5. The Emco Wheaton and EZ-flo A4000 and A4002 nozzles are permitted only when used in conjunction with certified vapor check valves.