


Exhibit 9c  
Executive Order G-70-52-AM  
High-Hang Coaxial Hose Configuration With Liquid Removal System  
For New and Existing Installations

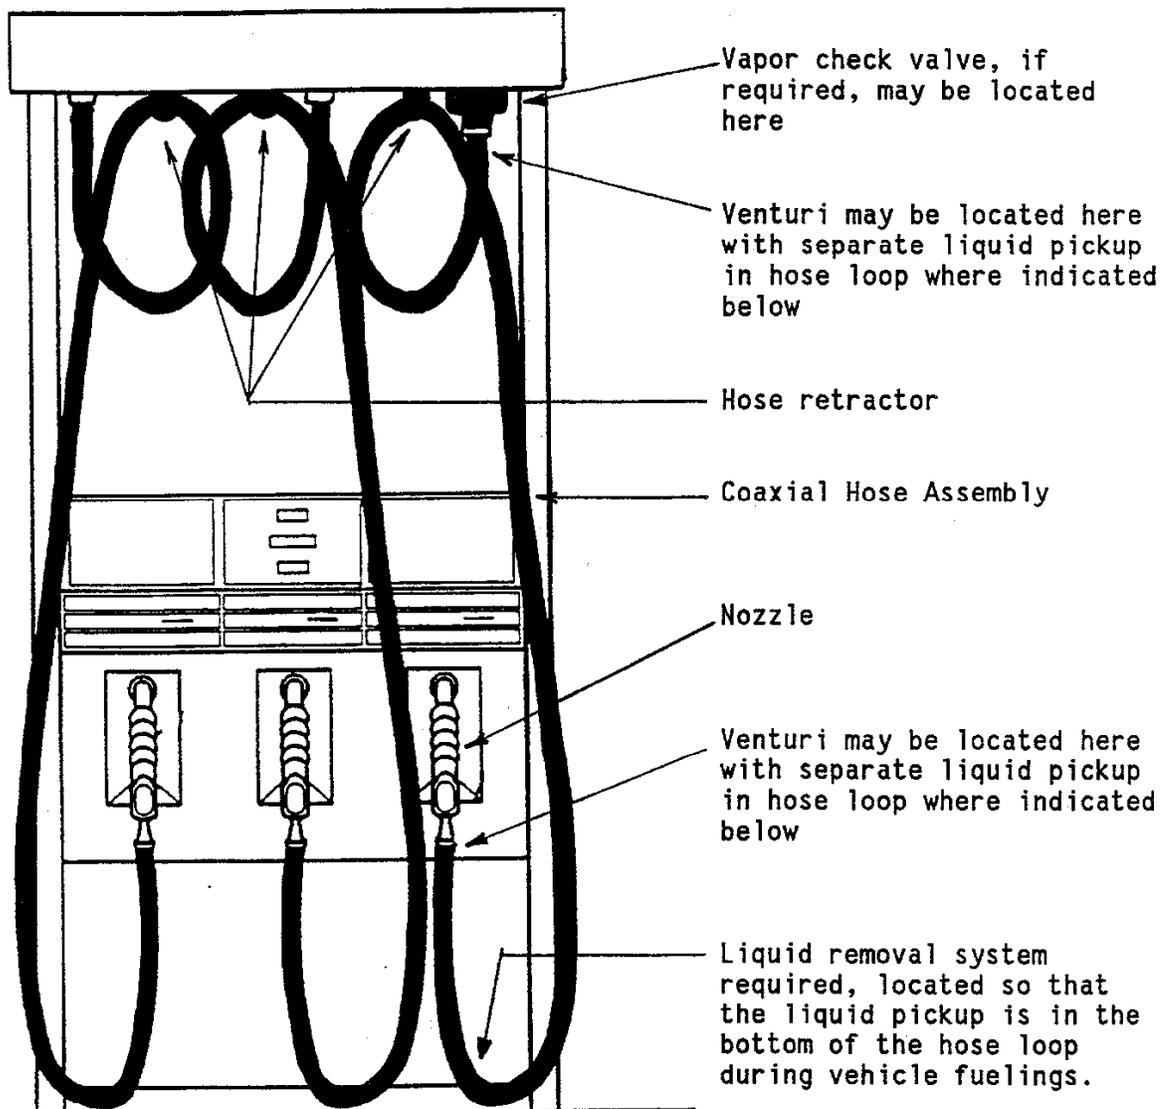

Notes:

1. Use 1 inch or larger inside diameter galvanized pipe for riser.
2. The maximum length of the hose assembly, including any breakaway valve, vapor check valve or pigtail hose, shall not exceed 13 feet.
3. An ARB certified liquid removal system must be installed and maintained according to the manufacturer's current specifications.
4. A flow limiter is required on all dispensers that have a maximum flowrate in excess of 10 gpm. A flow limiter may be required on all gasoline dispensers at the option of the local air pollution control district.
5. The Emco Wheaton and EZ-flo A4001 and A4003 nozzles are permitted only when used in conjunction with approved vapor check valves.
6. The hose may not touch the island or the ground when not in use. In the case of a dogbone island where the wider island ends protect the hose from damage by vehicle tires, the hose may touch the vertical face of the dogbone island at the option of the local air pollution control district.
7. Retractor must retract coaxial hose to top of dispensers when not in use.
8. Tension on hose clamp must not be in excess of that required to return hose to top of dispenser.