

INSTALLATION INSTRUCTIONS for HEALY SYSTEMS, INC. CLEAN AIR SEPARATOR

The Model 9961 or 9961H, Healy Systems Clean Air Separator (CAS) consists of a 400 gallon steel vapor processor vessel that contains a fuel resistant bladder to hold excess gasoline vapors that may develop in gasoline storage tanks during idle periods of gasoline dispensing facility operation. Models and Drawings with a “H” suffix apply to horizontal CAS installations and those without a “H” suffix apply to vertical CAS installations. The CAS assembly weighs approximately 800 pounds which makes it necessary to have a power assisted lifting device available at the installation site to remove the CAS from the transportation vehicle and place it on the required concrete pad (see drawing 9900-9945 or 9900-9945H). The pad (level within 1/8”/foot) is located within 100 feet to the gasoline storage tank vent lines. The pad is a requirement of this installation. **DO NOT PLACE THE CLEAN AIR SEPARATOR DIRECTLY ON THE GROUND OR ASPHALT SURFACE.** NOTICE: The installer is responsible to ensure that the installation meets the latest edition requirements of NFPA 30A, Chapter 10. No electrical connections are required. The CAS securement method shown in drawing 9900-9945 or 9900-9945H shall be approved by the local authority having jurisdiction with respect to wind and seismic loading. Installer shall not loosen, rotate or remove factory installed fittings or flange as this may damage factory seals and void warranty.

In addition to the vapor processor vessel, there is a hardware kit that contains the following:

- 4 Locking 1” NPT Ball Valves
- 4 Pad locks (keyed alike)
- 1 Breather Assembly, Healy Model 9948
- 1 Float Check Valve Assembly, Model 9466G

Reference the appropriate Healy Systems installation drawing (9900-9942, 9900-9942H, 9900-9971, 9900-9971H, 9900-9972, 9900-9972H, 9900-9973 or 9900-9973H of this manual) for placement of the above parts for the vent stack configuration required by the local Authority Having Jurisdiction (AHJ) for the Underground Storage Tank (UST) system. The local contractor is responsible to provide all necessary, galvanized piping, non-hardening, UL classified pipe joint compound and plumbing fittings. Additional Pressure/Vacuum (P/V) vent valves to complete installation are not included in the hardware kit. Healy is not responsible for the warranty of any other P/V vent valve purchased to complete installation.

The CAS arrives at the site assembled and tested. All plumbing shall be done using 1” galvanized steel pipe (Schedule 40) and approved nipples, as called out in the installation drawing appropriate for the site installation. Mounting hardware shall be galvanized or stainless steel. Careful attention must be paid to the installation drawing appropriate for the site installation to assure proper operation of the bladder system. Do not inflate the bladder assembly after installation.

It is important that the CAS be secured to the concrete pad as shown in drawing 9900-9945 or 9900-9945H of this manual to prevent any unintentional repositioning of the CAS as the connecting plumbing to the vent system is accomplished.

Franklin Fueling Systems
3760 Marsh Road
Madison, Wisconsin 53718 USA
ARB Approved Installation, Operation and Maintenance Manual

Website: <http://www.franklinfueling.com>
Email: sales@franklinfueling.com
Telephone: 800-225-9787
Fax: 608-838-6433



OPERATION AND PURGING

NORMAL OPERATION:

- There are four ball valves on the CAS. Each ball valve is to be installed so as to allow opening and closing with nothing obstructing the full range (90°) of movement. In normal operation, only the valve (A) at the top of the CAS shall be open – the other three valves (B, C and D) shall be closed. All four valves shall be locked in the above positions. The two plugs (E and F) should be installed using a non-hardening, UL classified pipe joint compound and tightened to 60 ft-lbs.

DRAINING THE BLADDER:


- Any liquid coming over from the vent system would have collected above the valve (A) in the riser pipe before going into the bladder. An inspection of the need to drain the bladder is easily made by removing the plug (E) at the tee on the bottom plumbing of the CAS. Before removing this plug, open the valve (B) above the tee to release any liquid into the piping below. Wait approximately 30 seconds and then close the valve (B). Now, remove the plug (E) at the tee on the bottom plumbing of the CAS – be sure to have a container suitable for gasoline available to catch fluid. If liquid in excess of 16 ounces (473 ml) drains out, the bladder should also be drained.
- Should it be necessary to drain the bladder:
 1. Close the upper ball valve (A) (usually open) leading to the gasoline storage tank vent lines.
 2. Open the valve (C) that goes to the internal syphon tube. Be sure the other three ball valves (A, B and D) that connect to the vent lines and CAS are closed.
 3. Remove the plug (E) from the bottom tee and connect an explosion proof evacuation pump capable of handling liquid. Have a liquid tight, container suitable for gasoline positioned to receive any fluid that may exit the system and start the pump. If no liquid returns within 30 seconds, the bladder is dry – discontinue pumping, remove the pump, replace the plug (E) and return the ball valves to their normal, locked, positions.

DRAINING THE CAS:

- Should it be necessary to drain the CAS (between the bladder and steel wall):
 1. Close the ball valve at the top (A) of the CAS and also the two valves (B and C) on the vertical risers.
 2. Remove the plug (E) in the bottom tee and place a metal container below the pipe opening.
 3. Carefully open the ball valve (D) at the bottom of the CAS – observe that the container that is being drained into does not overflow – empty container as required until fluid no longer comes from the pipe when the valve is open.
 4. Close the ball valve (D) and replace the plug (E) into the tee.
 5. Return all ball valves to their normal locked positions.



DRW NO: 9900-9945

CRITERIA
 SOIL BEARING = 1000 psf ADJ.
 SEISMIC ZONE 4 N₂ = 1.3
 CS=3.4KANS

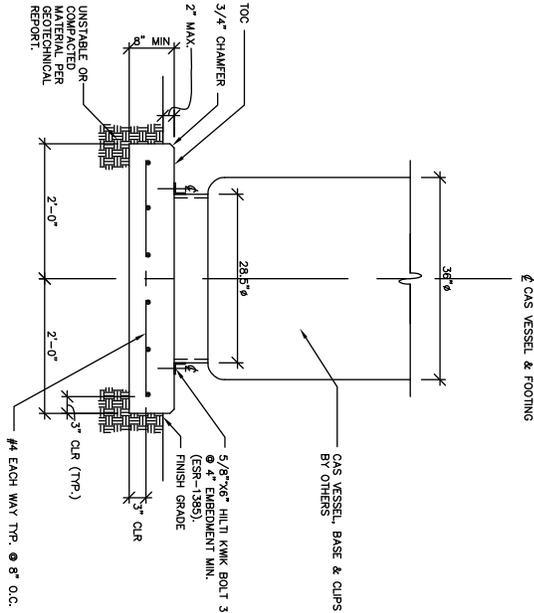

NOTES:
 CONCRETE COMP. STRENGTH = 2500 psi
 MIN. REIN. YIELD STRENGTH = 40000 psi

SCALE = 3/4" = 1'-0"

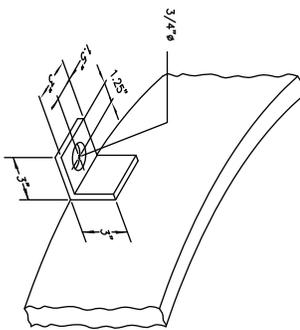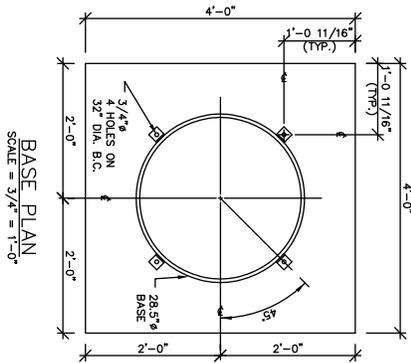

TYPICAL HOLD DOWN CLIP
 SCALE = NONE

The information disclosed herein is the property of Franklin Fueling Systems, Inc. Neither this drawing nor the information disclosed herein may be reproduced or transmitted to other documents or purposes, except as specifically authorized in writing by Franklin Fueling Systems. This drawing must be returned to Franklin Fueling Systems upon request.


MATERIAL:		DO NOT SCALE DRAWING		XX ± .02	
STANDARD INCH TOLERANCES (UNLESS OTHERWISE SPECIFIED)		ANGULAR ± 1/2°		XXX ± .005	
SPECIAL DIST:					
TITLE:		CLEAN AIR SEPARATOR MOUNTING SLAB DETAILS		SUFFIX:	
DRWN:	DATE:	DRW NO:	9900-9945		
JWH	07/31/02				
APPRV:	DATE:	SCALE:	1/8	SHEET	1 OF 1




REV	DESCRIPTION	ECN NO	BY	DATE
5	ADDED "CAS VESSEL"	-	TF	10/24/07
4	ESR-1385 WAS IC80 ER4627	-	TF	07/23/07

CRITERIA
 SOIL BEARING = 1000 psf ADJ.
 SEISMIC ZONE 4 N_s=1.5
 C_s=0.44N_s

DRW No: 9900-9945H

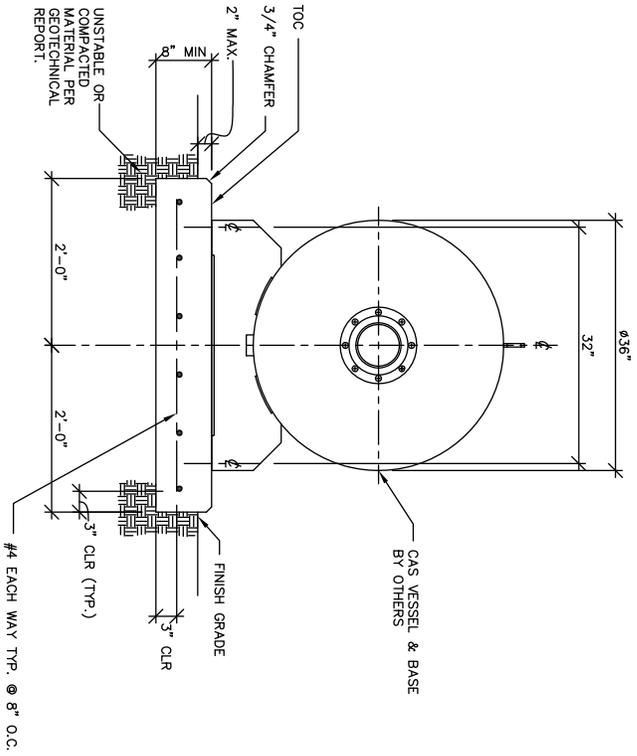

SECTION @ CAS SLAB
 NOTES:
 MIN. CONCRETE COMP STRENGTH = 2500 psi
 MIN. REINF. YIELD STRENGTH = 40000 psi

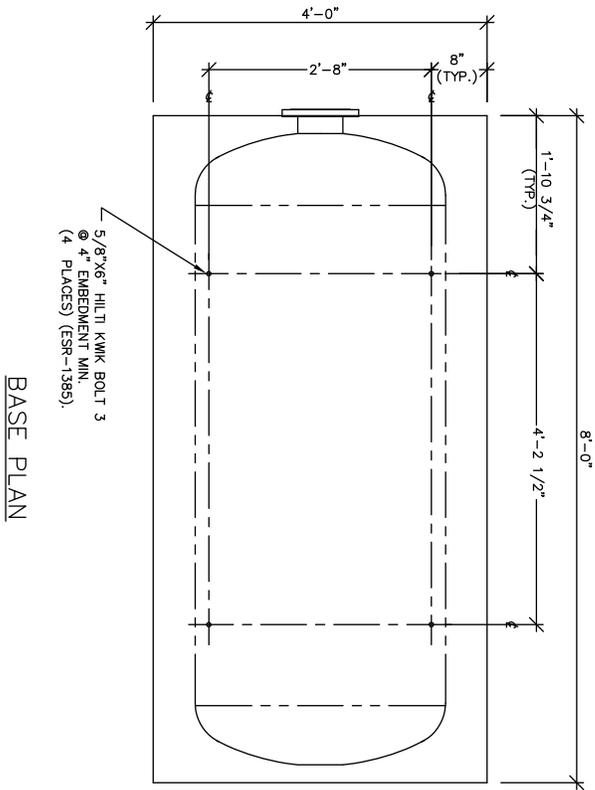

BASE PLAN

REV	DESCRIPTION	ECN NO	BY	DATE
3	ADDED "CAS VESSEL"	-	TF	10/24/07
2	ESR-1385 WAS ICBO ER4627	-	TF	07/23/07




Madison, WI 53718

The information disclosed hereon includes proprietary rights of Franklin Fueling Systems, Inc. Neither this drawing nor the information disclosed thereon may be reproduced or transferred to other documents, or used or disclosed to others for any purpose, except as specifically authorized in writing by Franklin Fueling Systems. This drawing must be returned to Franklin Fueling Systems upon request.

MATERIAL:	DO NOT SCALE DRAWING	.XX ± .02
	STANDARD INCH TOLERANCES (UNLESS OTHERWISE SPECIFIED)	.XXX ± .005
	SPECIAL DIST:	ANGULAR ± 1/2°

TITLE:		CLEAN AIR SEPARATOR HORIZONTAL MOUNTING SLAB DETAILS	
DRAWN:	DATE:	DRW NO:	SUFFIX:
TF	05/22/07	9900-9945	H
APPRVL:	DATE:	SCALE:	SHEET
MDB	06/05/07	3/4" = 1"	1 OF 1

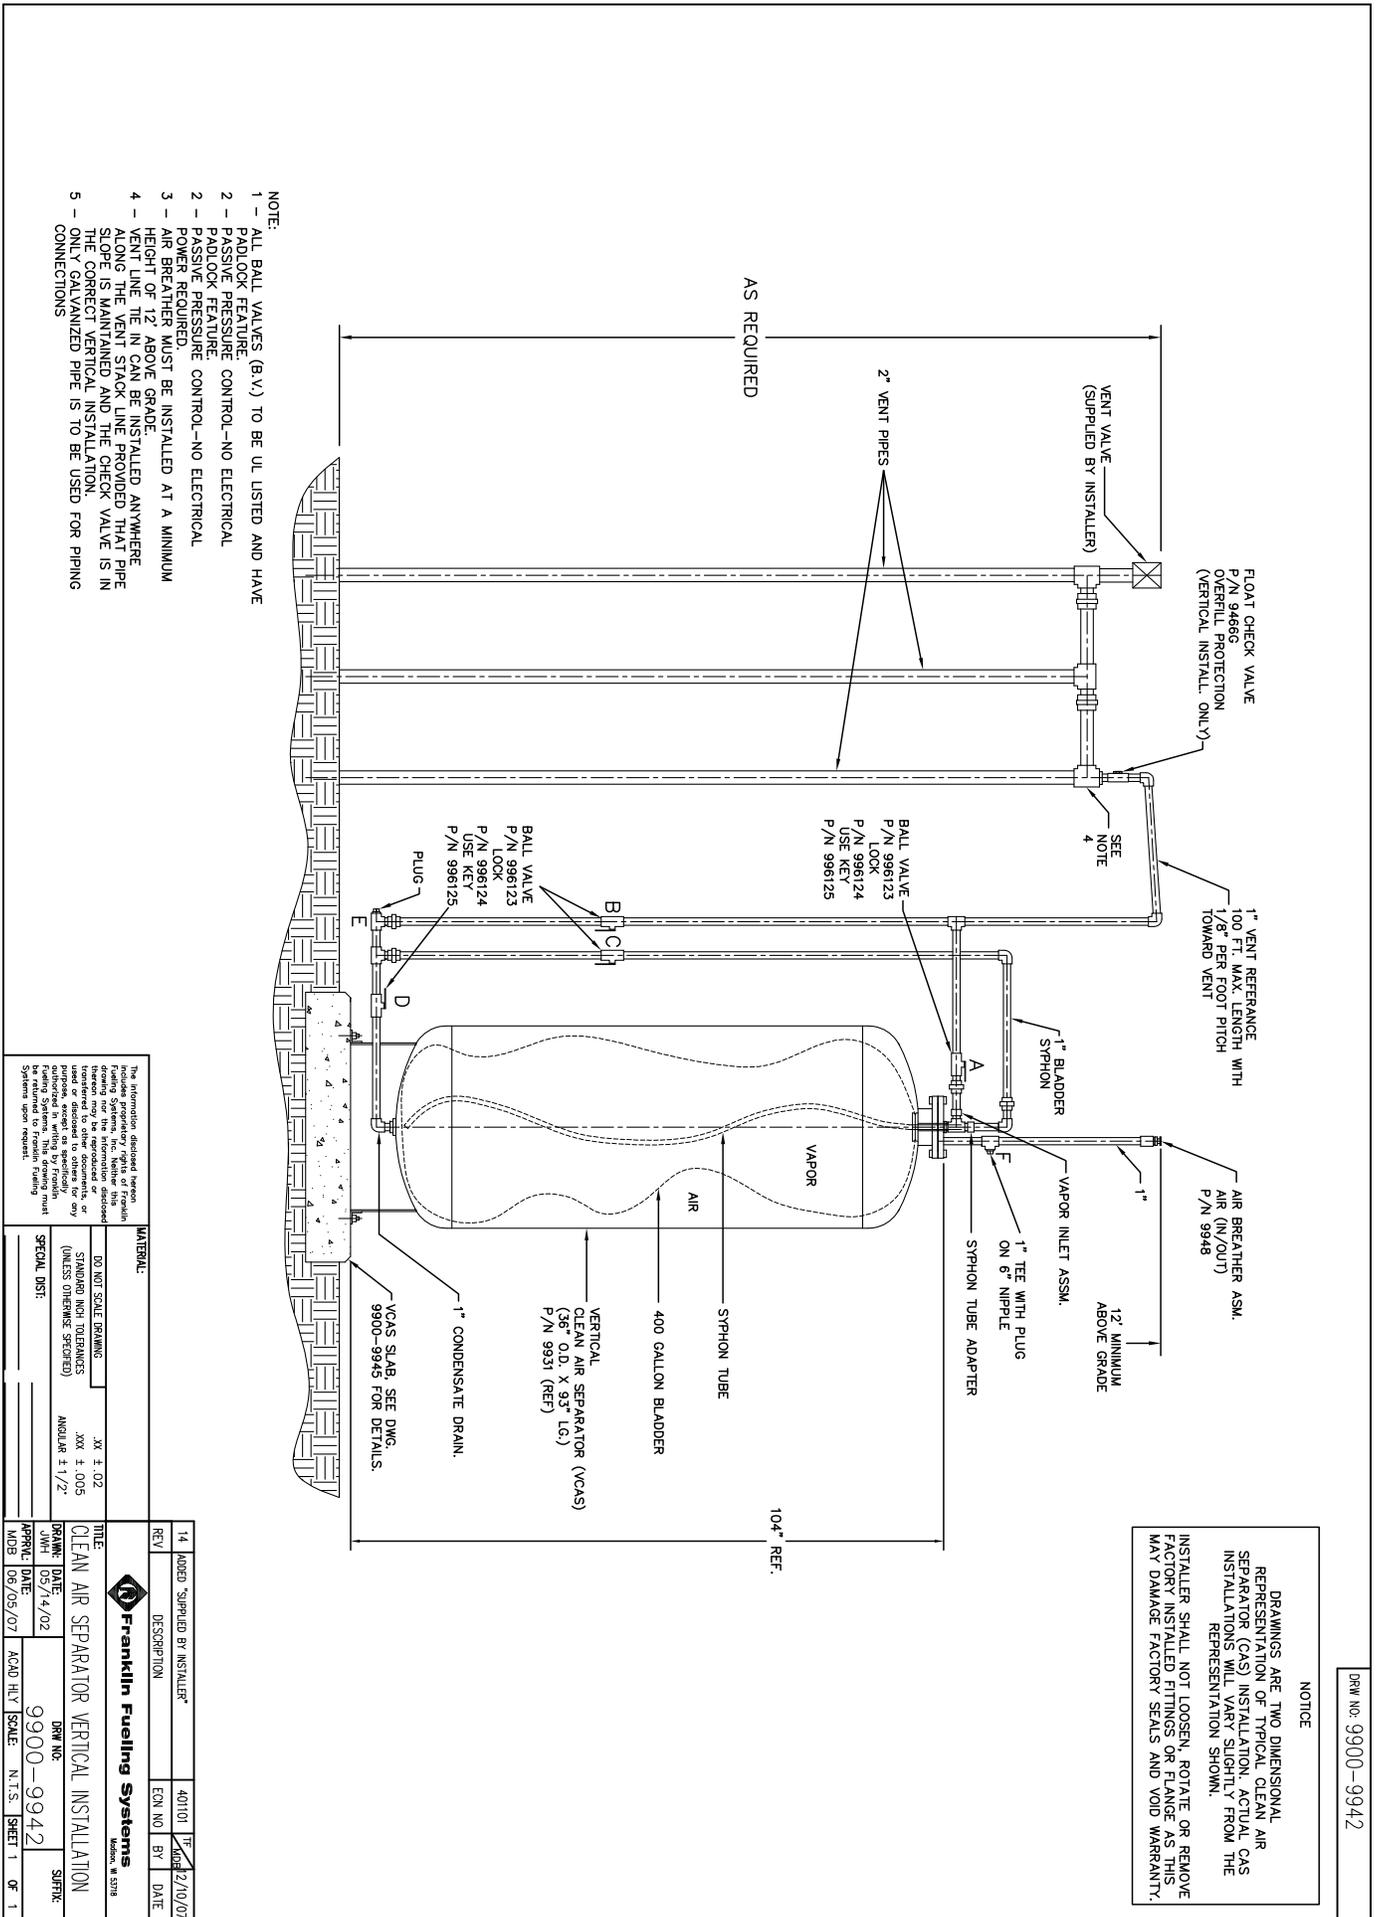

- NOTE:
- 1 - ALL BALL VALVES (B.V.) TO BE UL LISTED AND HAVE PADLOCK FEATURE. CONTROL—NO ELECTRICAL
 - 2 - PASSIVE PRESSURE CONTROL—NO ELECTRICAL PADLOCK FEATURE
 - 3 - PASSIVE PRESSURE CONTROL—NO ELECTRICAL POWER REQUIRED.
 - 4 - AIR BREAKER MUST BE INSTALLED AT A MINIMUM HEIGHT OF 12" ABOVE GRADE
 - 5 - VENT LINE TE IN CAN BE INSTALLED ANYWHERE ALONG THE VENT STACK LINE PROVIDED THAT PIPE SLOPE IS MAINTAINED AND THE CHECK VALVE IS IN THE CORRECT VERTICAL INSTALLATION.
 - 6 - ONLY GALVANIZED PIPE IS TO BE USED FOR PIPING CONNECTIONS

NOTICE
 DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATION SHALL BE DETERMINED FROM THE REPRESENTATION SHOWN.
 INSTALLER SHALL NOT LOOSEN, ROTATE OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE AS THIS MAY DAMAGE FACTORY SEALS AND VOID WARRANTY.


DRW NO: 9900-9942

The information disclosed herein includes proprietary rights of Franklin Fueling Systems, Inc. and its subsidiaries. This information is intended for use only by the recipient and is not to be reproduced, stored in a retrieval system, or used or disclosed to others for any purpose without the written consent of Franklin Fueling Systems, Inc. or its subsidiaries. This drawing must be used in accordance with the Franklin Fueling Systems, Inc. drawing and specifications.	
MATERIAL:	DO NOT SCALE DRAWING
SCALE:	XX ± .02
STANDARD (AS APPLIED TO THIS DRAWING)	XXX ± .005
ANGULAR ± 1/2"	
SPECIAL DST:	
TITLE:	CLEAN AIR SEPARATOR VERTICAL INSTALLATION
DRAWN:	JWH
DATE:	05/14/02
APPVAL:	MOB
DATE:	06/05/07
ACAD HVY:	SCALE: N.T.S.
SHEET:	1 OF 1



Franklin Fueling Systems
 MODEL M 5218

REV	14	ADDED "SUPPLIED BY INSTALLER"	401101	15	06/22/02/07
REV		DESCRIPTION	EON NO	BY	DATE

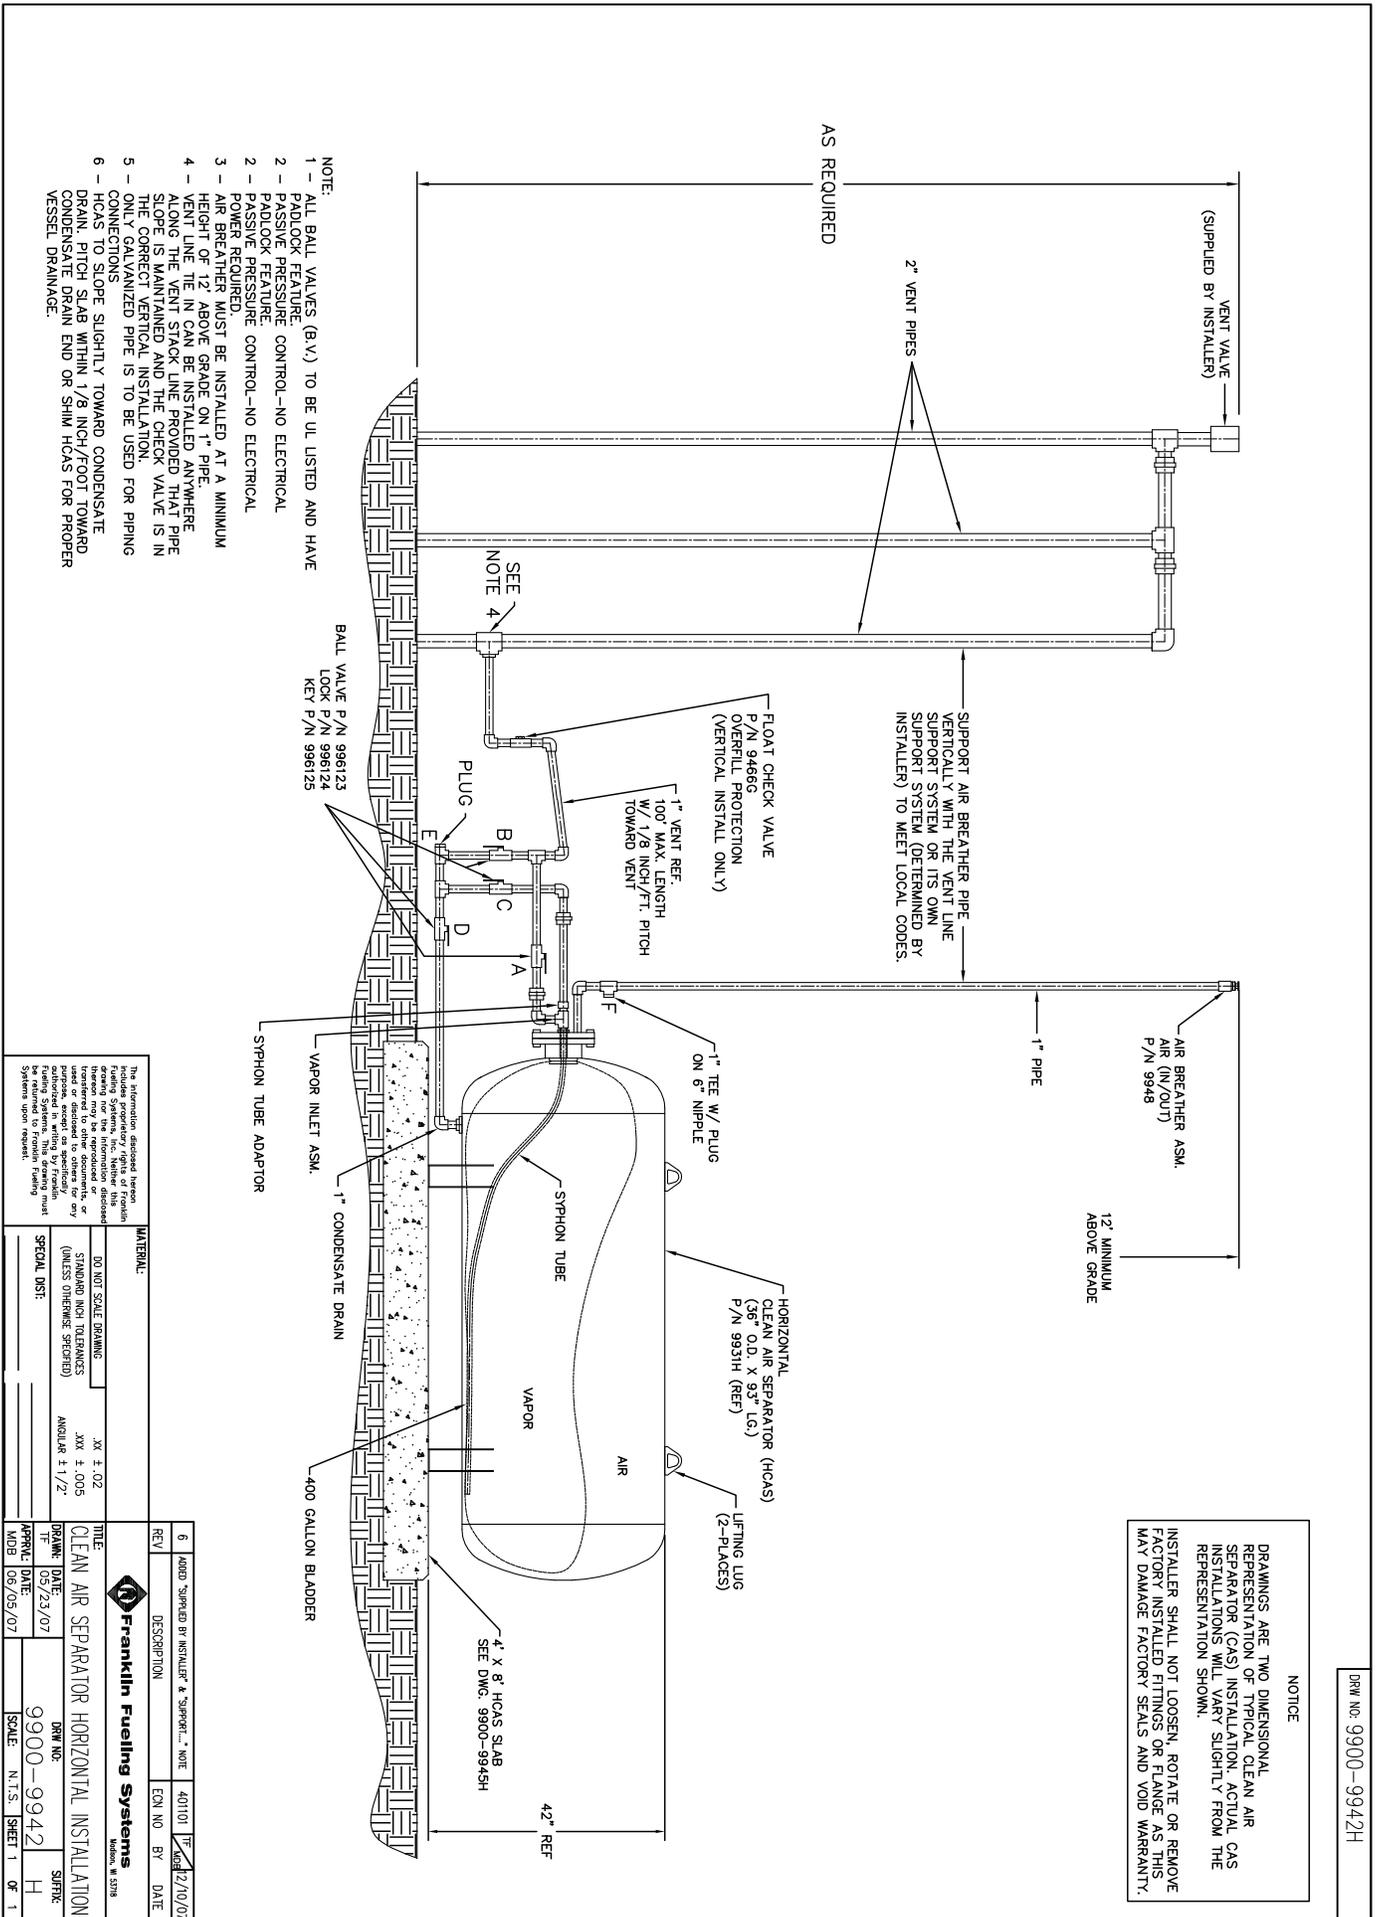

NOTICE

DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATIONS WILL VARY SLIGHTLY FROM THE REPRESENTATION SHOWN.

INSTALLER SHALL NOT LOOSEN, ROTATE OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE AS THIS MAY DAMAGE FACTORY SEALS AND VOID WARRANTY.

DWG NO: 9900-9942H


The information disclosed herein includes proprietary rights of Franklin Fuelling Systems, Inc. and is intended for use only for the information disclosed herein. No reproduction or use of this information is permitted without the written consent of Franklin Fuelling Systems, Inc. This drawing must be used as is. Franklin Fuelling Systems, Inc. reserves the right to change this drawing without notice.

MATERIAL:	DO NOT SCALE DRAWING	XXX ± .02
	STANDARD NICK TOLERANCES (UNLESS OTHERWISE SPECIFIED)	ANGULAR ± 1/2°
SPECIAL DIST:		

TITLE:	CLEAN AIR SEPARATOR HORIZONTAL INSTALLATION
DRAWN:	DATE: 05/23/07
APPROVED:	DATE: 05/05/07
SCALE:	N.T.S.
SHEET:	1 OF 1



REV:	6	4000	Revised by INSTALLED * Superior... * Note	401101	12/10/07
DESCRIPTION:					

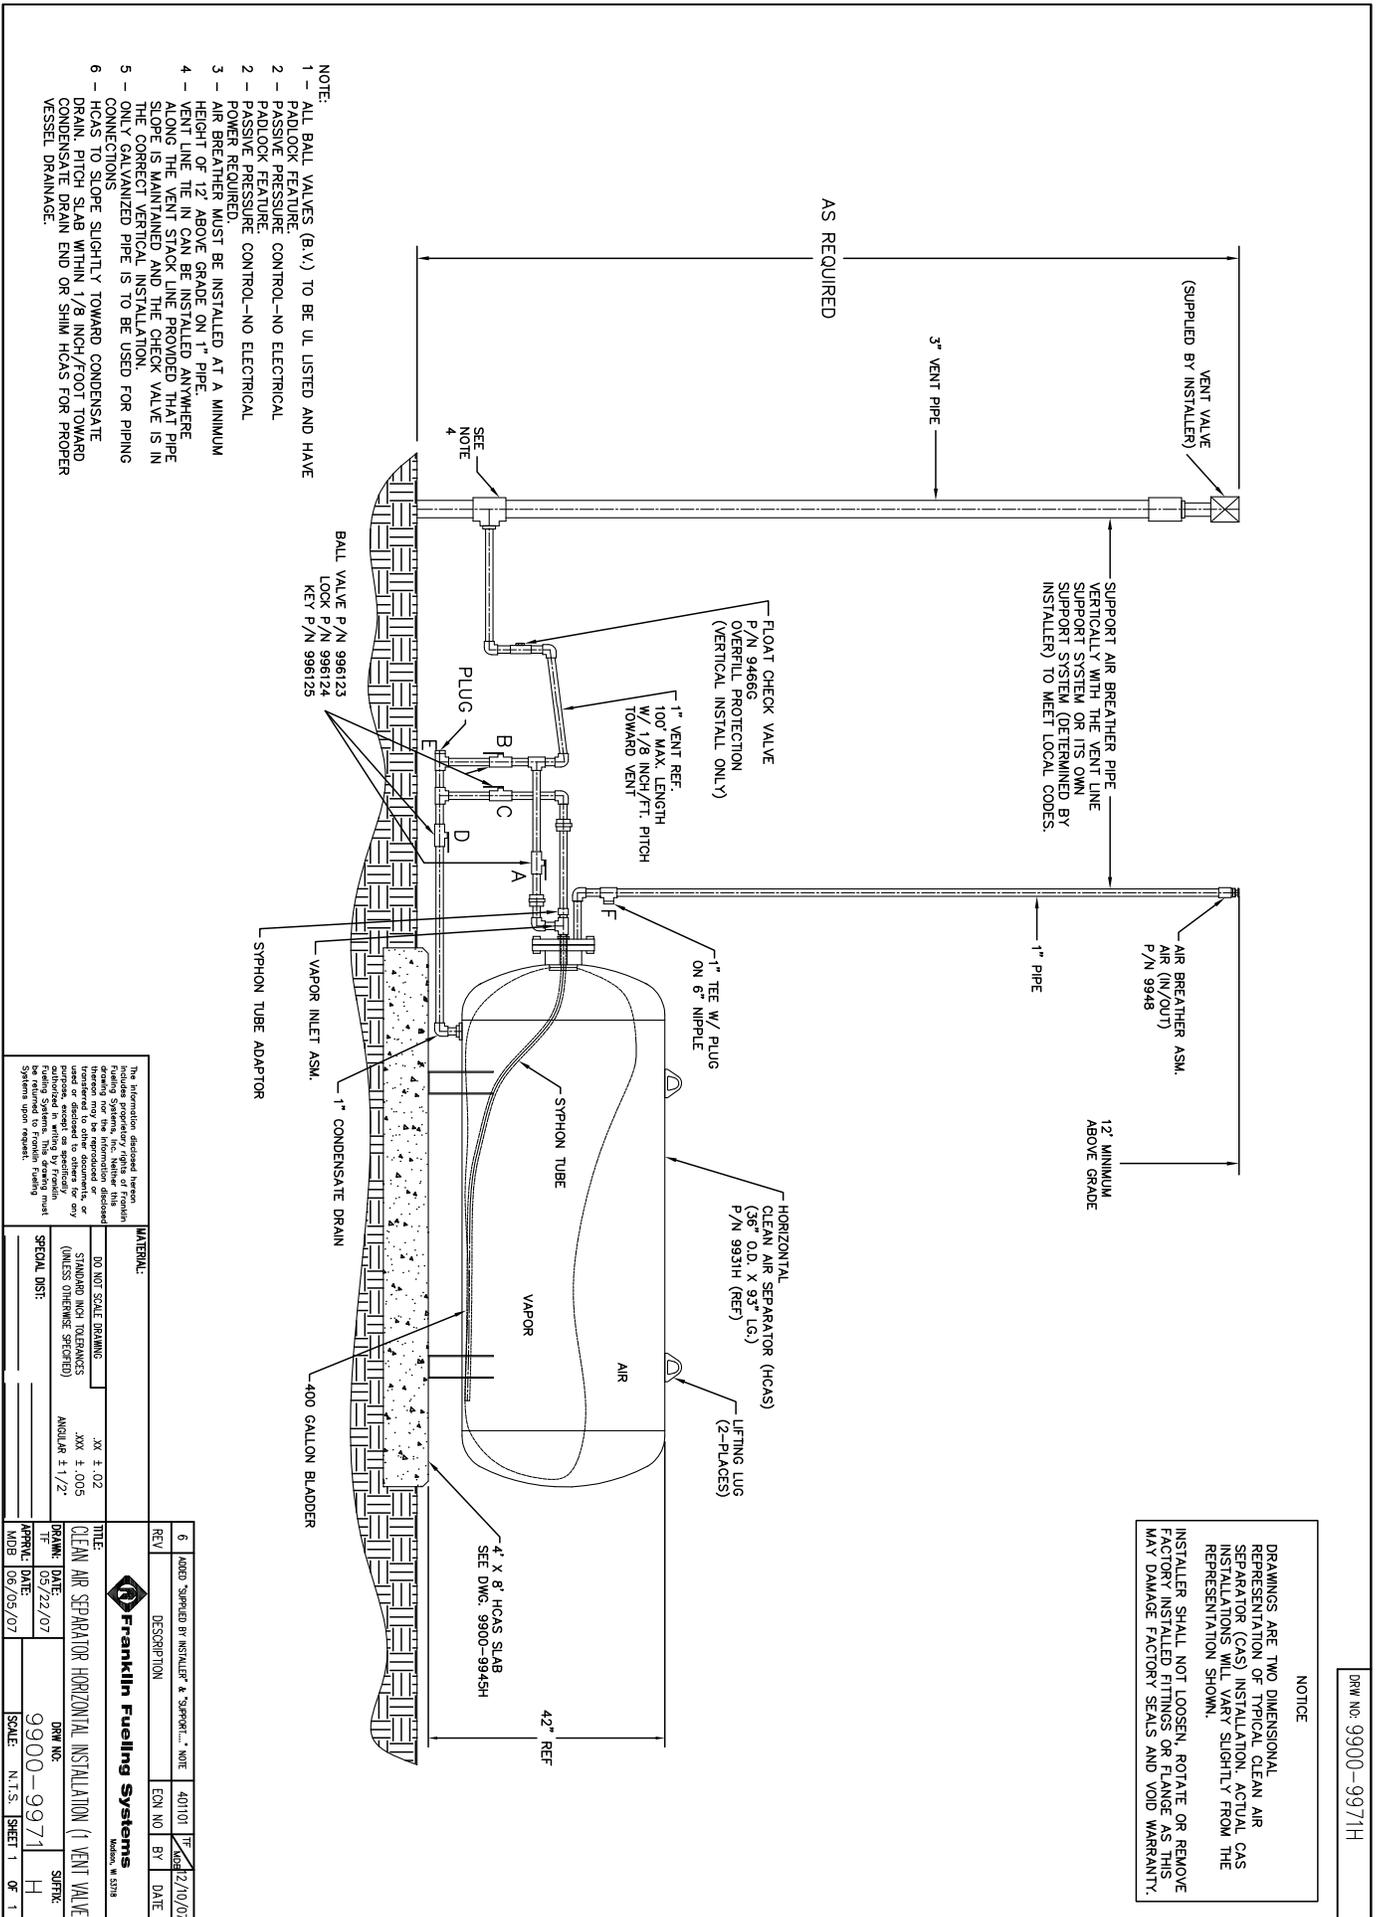

NOTICE

DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATIONS WILL VARY SLIGHTLY FROM THE REPRESENTATION SHOWN.

INSTALLER SHALL NOT LOOSEN, ROTATE, OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE AS THIS MAY DAMAGE FACTORY SEALS AND VOID WARRANTY.


DRW NO: 9900-9971H

The information disclosed herein includes proprietary rights of Franklin Fuelling Systems, Inc. and is intended for use only for the information disclosed herein. It may be reproduced or used or disclosed to others for any purpose without the written consent of Franklin Fuelling Systems, Inc. This drawing must be used as is. No other use is permitted without the written consent of Franklin Fuelling Systems, Inc.

MATERIAL:	
DO NOT SCALE DRAWING	XX ± .02
STANDARD NOT TOLERANCES (UNLESS OTHERWISE SPECIFIED)	.XXX ± .005
SPECIAL DIST:	ANGULAR ± 1/2°

TITLE:		FRANKLIN Fuelling Systems	
CLEAN AIR SEPARATOR HORIZONTAL INSTALLATION (1 VENT VALVE)		DRW NO:	9900-9971
DRAWN:	TF	DATE:	05/22/07
APPROV:	MDB	DATE:	06/05/07
SCALE:	N.T.S.	SHEET:	1 OF 1

REV	DESCRIPTION	EON NO	BY	DATE
6	Added "Supplied by Installer" & "Support" note	401101	TF	05/21/07

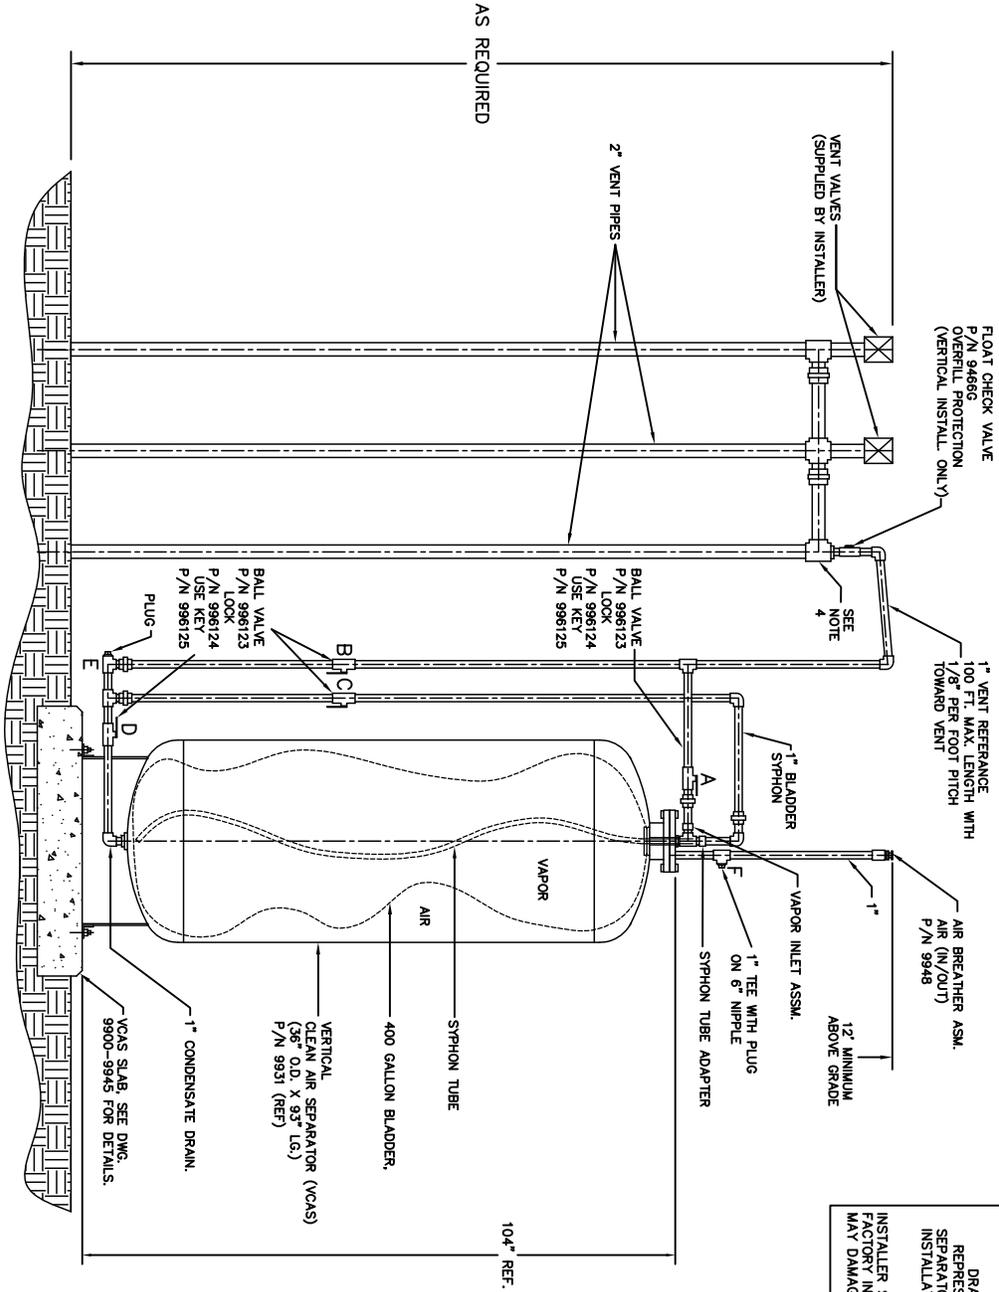

- NOTE:
- 1 - ALL BALL VALVES (B.V.) TO BE UL LISTED AND HAVE PADLOCK FEATURE.
 - 2 - PASSIVE PRESSURE CONTROL--NO ELECTRICAL PADLOCK FEATURE.
 - 3 - PASSIVE PRESSURE CONTROL--NO ELECTRICAL POWER REQUIRED.
 - 4 - AIR BREAKER MUST BE INSTALLED AT A MINIMUM HEIGHT OF 12' ABOVE GRADE.
 - 5 - VENT LINE THE IN CAN BE INSTALLED ANYWHERE ALONG THE VENT STACK LINE PROVIDED THAT PIPE SLOPE IS MAINTAINED AND THE CHECK VALVE IS IN THE CORRECT VERTICAL INSTALLATION.
 - 6 - ONLY GALVANIZED PIPE IS TO BE USED FOR PIPING CONNECTIONS

NOTICE

DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATIONS WILL VARY SLIGHTLY FROM THE REPRESENTATION SHOWN.


INSTALLER SHALL NOT LOOSEN, ROTATE OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE ASSEMBLY. FACTORY DAMAGE FACTORY SEALS AND VOID WARRANTY.

DRW NO: 9900-9972

The information disclosed herein includes proprietary rights of Franklin Fueling Systems, Inc. and is intended for use only by the recipient. It is not to be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Franklin Fueling Systems, Inc. This drawing must be used in accordance with the Franklin Fueling Systems, Inc. drawing system upon request.

MATERIAL:	
DO NOT SCALE DRAWING	XX ± 0.02
STANDARD RICH TOLERANCES (UNLESS OTHERWISE SPECIFIED)	.XXX ± 0.005
SPECIAL INST:	ANGULAR ± 1/2°

7	ADDED "SUPPLIED BY INSTALLER"	40101	15	06/27/07
REV	DESCRIPTION	EON NO	BY	DATE
TITLE: CLEAN AIR SEPARATOR VERTICAL INSTALLATION (2 VENT)				
DATE:	05/14/02	DRW NO:	9900-9972	
DATE:	05/05/07	ACAD HWY SCALE:	N.T.S.	SHEET 1 OF 1

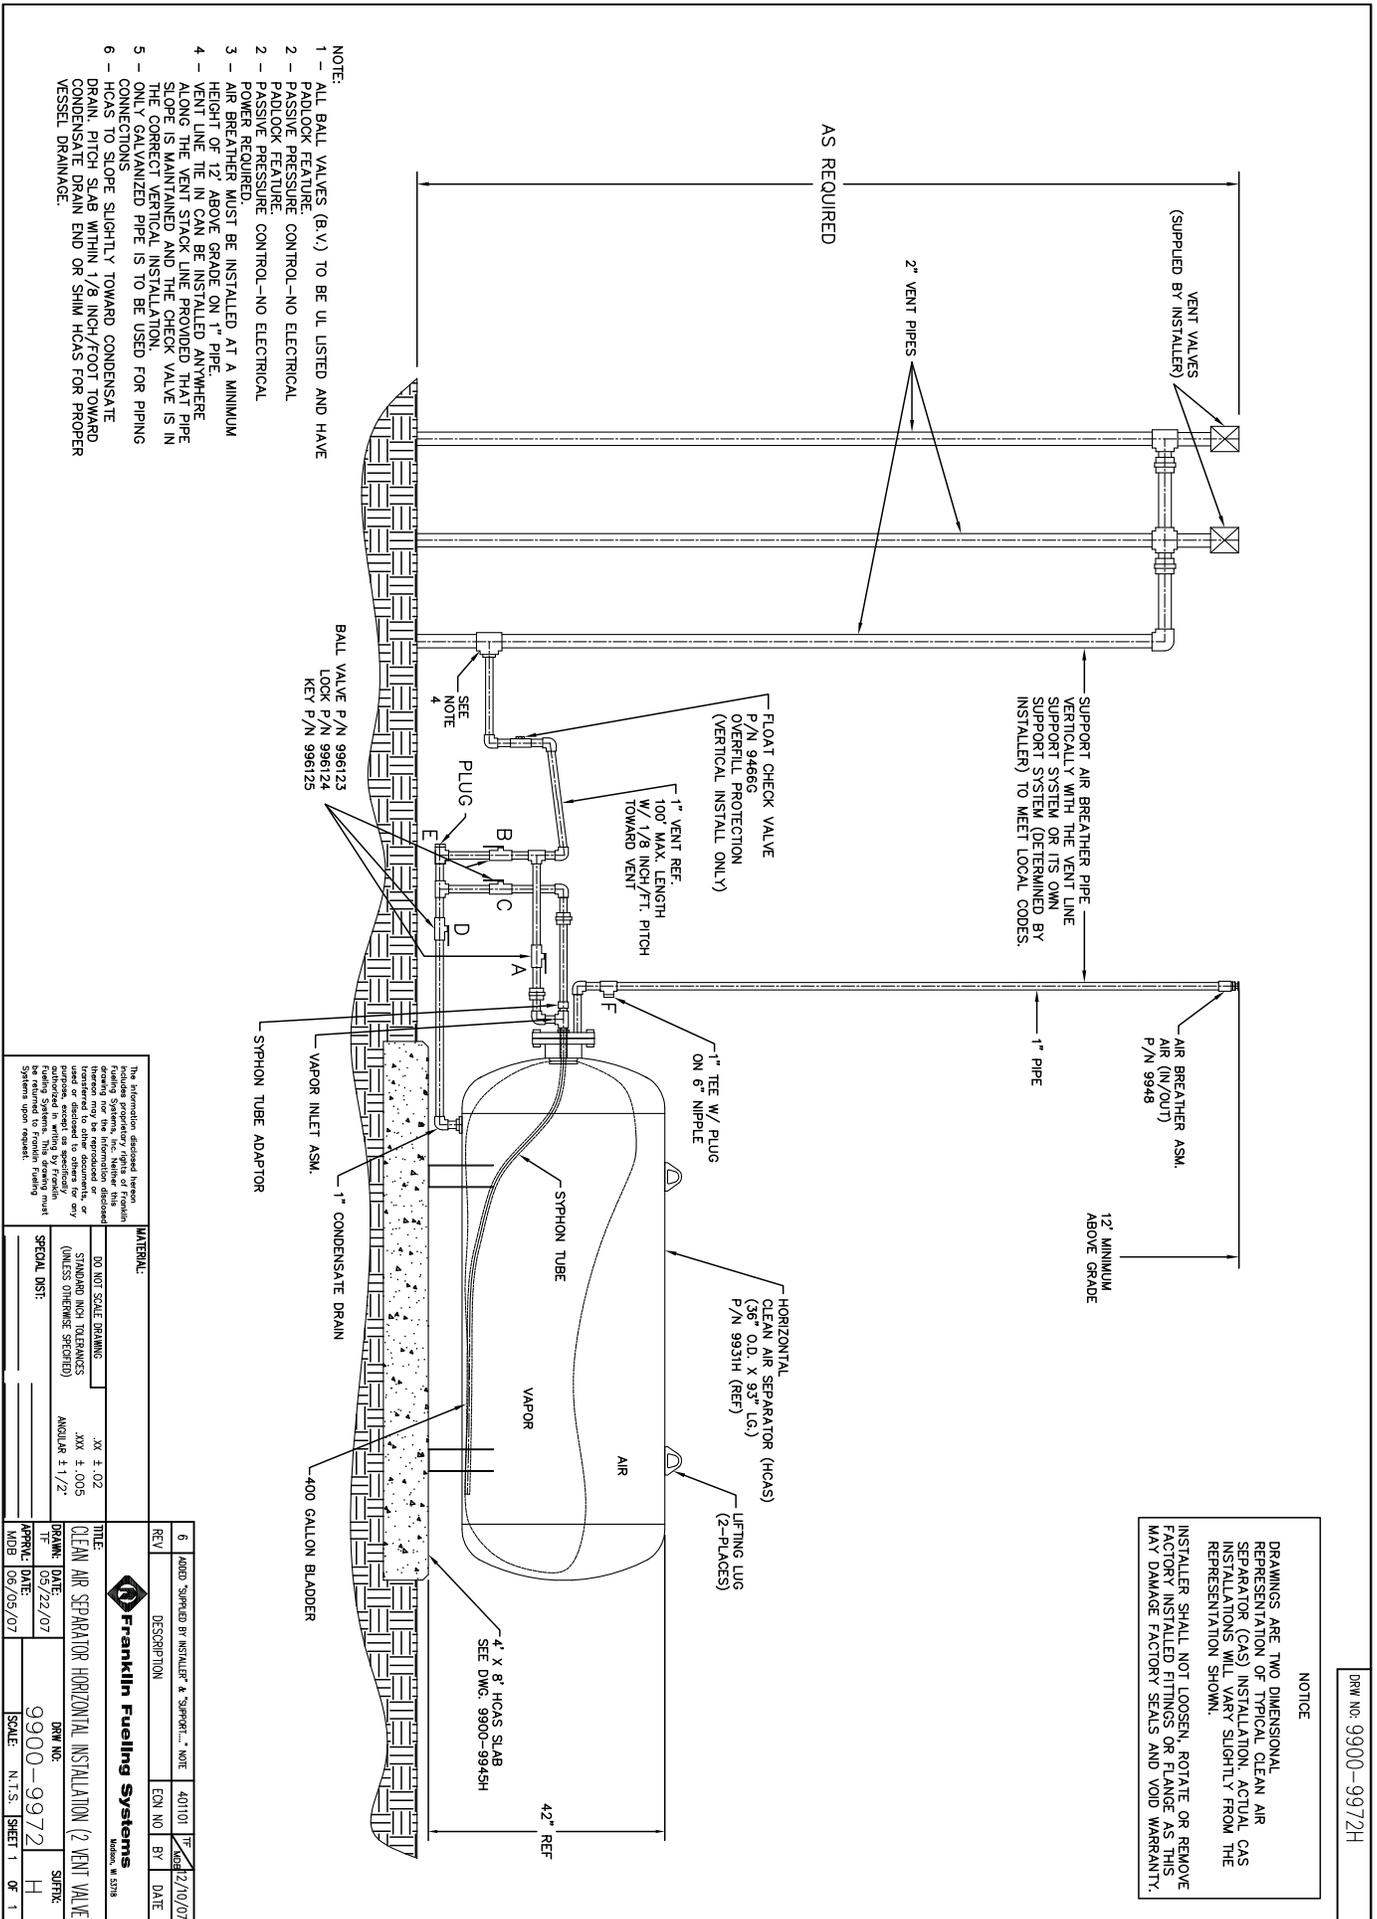

- NOTE:
- 1 – ALL BALL VALVES (B.V.) TO BE UL LISTED AND HAVE PADLOCK FEATURE CONTROL-NO ELECTRICAL PASSIVE PRESSURE
 - 2 – PASSIVE PRESSURE CONTROL-NO ELECTRICAL POWER REQUIRED
 - 3 – AIR BREATHER MUST BE INSTALLED AT A MINIMUM HEIGHT OF 12\"/>
 - 4 – VENT LINE THE IN CAN BE INSTALLED ANYWHERE ALONG THE VENT STACK LINE PROVIDED THAT PIPE SLOPE IS MAINTAINED AND THE CHECK VALVE IS IN THE CORRECT VERTICAL INSTALLATION.
 - 5 – ONLY GALVANIZED PIPE IS TO BE USED FOR PIPING CONNECTIONS
 - 6 – HCAPS TO SLOPE SLIGHTLY TOWARD CONDENSATE DRAIN, PITCH SLAB WITHIN 1/8 INCH/FOOT TOWARD CONDENSATE DRAIN END OR SHIM HCAPS FOR PROPER VESSEL DRAINAGE.

NOTICE

DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATIONS MUST BE SLOTTED FROM THE REPRESENTATION SHOWN.

INSTALLER SHALL NOT LOOSEN, ROTATE OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE AS THIS MAY DAMAGE FACTORY SEALS AND VOID WARRANTY.

The information disclosed herein includes proprietary rights of Franklin and is not to be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Franklin Fueling Systems. This drawing must be used as a guide only. Franklin Fueling Systems upon request.

MATERIAL:	
DO NOT SCALE DRAWING	XX ± .02
STANDARD INCH DIMENSIONS (UNLESS OTHERWISE SPECIFIED)	.XXX ± .005
SPECIAL DIST.	ANGULAR ± 1/2°


TITLE:		DRAWN NO:		SHEET:	
CLEAN AIR SEPARATOR HORIZONTAL INSTALLATION (2 VENT VALVE)		9900-9972		H	
DATE:	05/22/07	DATE:	05/22/07	SCALE:	N.T.S.
APP'D:	MDB	DATE:	05/05/07	SHEET:	1 OF 1

REV	DESCRIPTION	EON NO	BY	DATE
6	Added Siphon Tube Adapter & Siphon Tube	401101	BY	12/10/07



Model B 5218

DWG NO: 9900-9972H

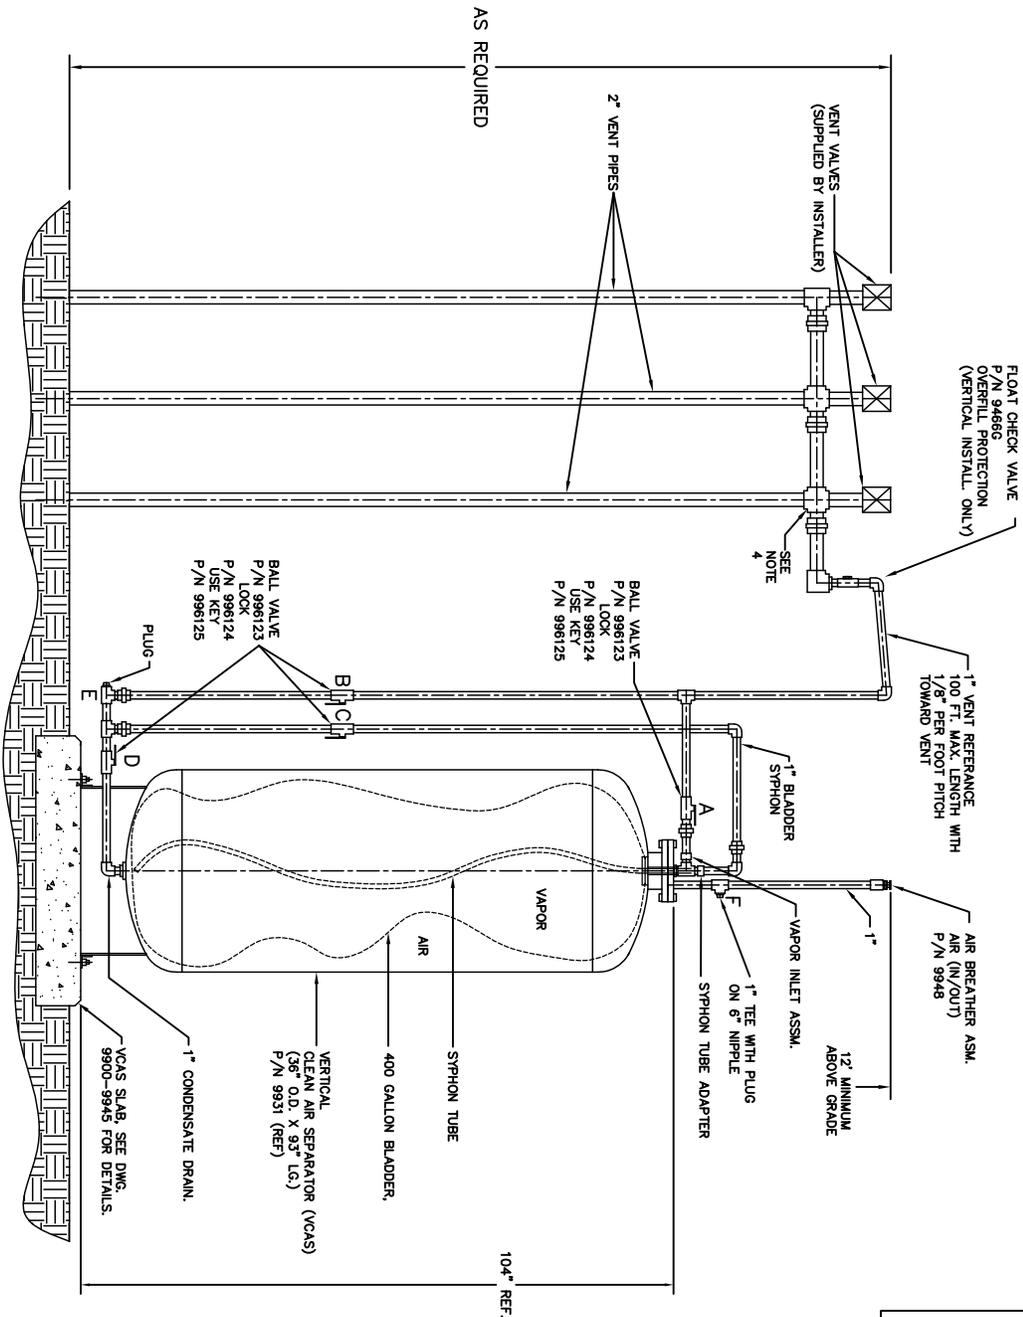

- NOTE:
- 1 – ALL BALL VALVES (B.V.) TO BE UL LISTED AND HAVE PADLOCK FEATURE. CONTROL--NO ELECTRICAL.
 - 2 – PASSIVE PRESSURE CONTROL--NO ELECTRICAL.
 - 3 – AIR BREATHER MUST BE INSTALLED AT A MINIMUM HEIGHT OF 12" ABOVE GRADE.
 - 4 – VENT LINE THE IN CAN BE INSTALLED ANYWHERE ALONG THE VENT STACK LINE PROVIDED THAT PIPE SLOPE IS MAINTAINED AND THE CHECK VALVE IS IN THE CORRECT VERTICAL INSTALLATION.
 - 5 – ONLY UL LISTED PIPE IS TO BE USED FOR PIPING CONNECTION

NOTICE

DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATIONS WILL VARY SLIGHTLY FROM THE REPRESENTATION SHOWN.

INSTALLER SHALL NOT LOOSEN, ROTATE OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE AS THIS MAY DAMAGE FACTORY SEALS AND VOID WARRANTY.


DRW NO: 9900-9973

The information disclosed herein includes proprietary rights of Franklin Fuelling Systems, Inc. and is intended for use only by the recipient. It is not to be reproduced or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Franklin Fuelling Systems, Inc. This drawing must be used in accordance with the Franklin Fuelling Systems upon request.

MATERIAL:	
DO NOT SCALE DRAWING	XX ± .02
STANDARD RICH TOLERANCES (UNLESS OTHERWISE SPECIFIED)	.XXX ± .005
SPECIAL INST:	ANGULAR ± 1/2°

TITLE:	
CLEAN AIR SEPARATOR VERTICAL INSTALLATION (3 VENT)	DRW NO: 9900-9973
DRAWN: JWH	DATE: 05/14/02
APPROVED: JWH	SCALE: N.T.S.
DATE: 05/05/07	SHEET 1 OF 1



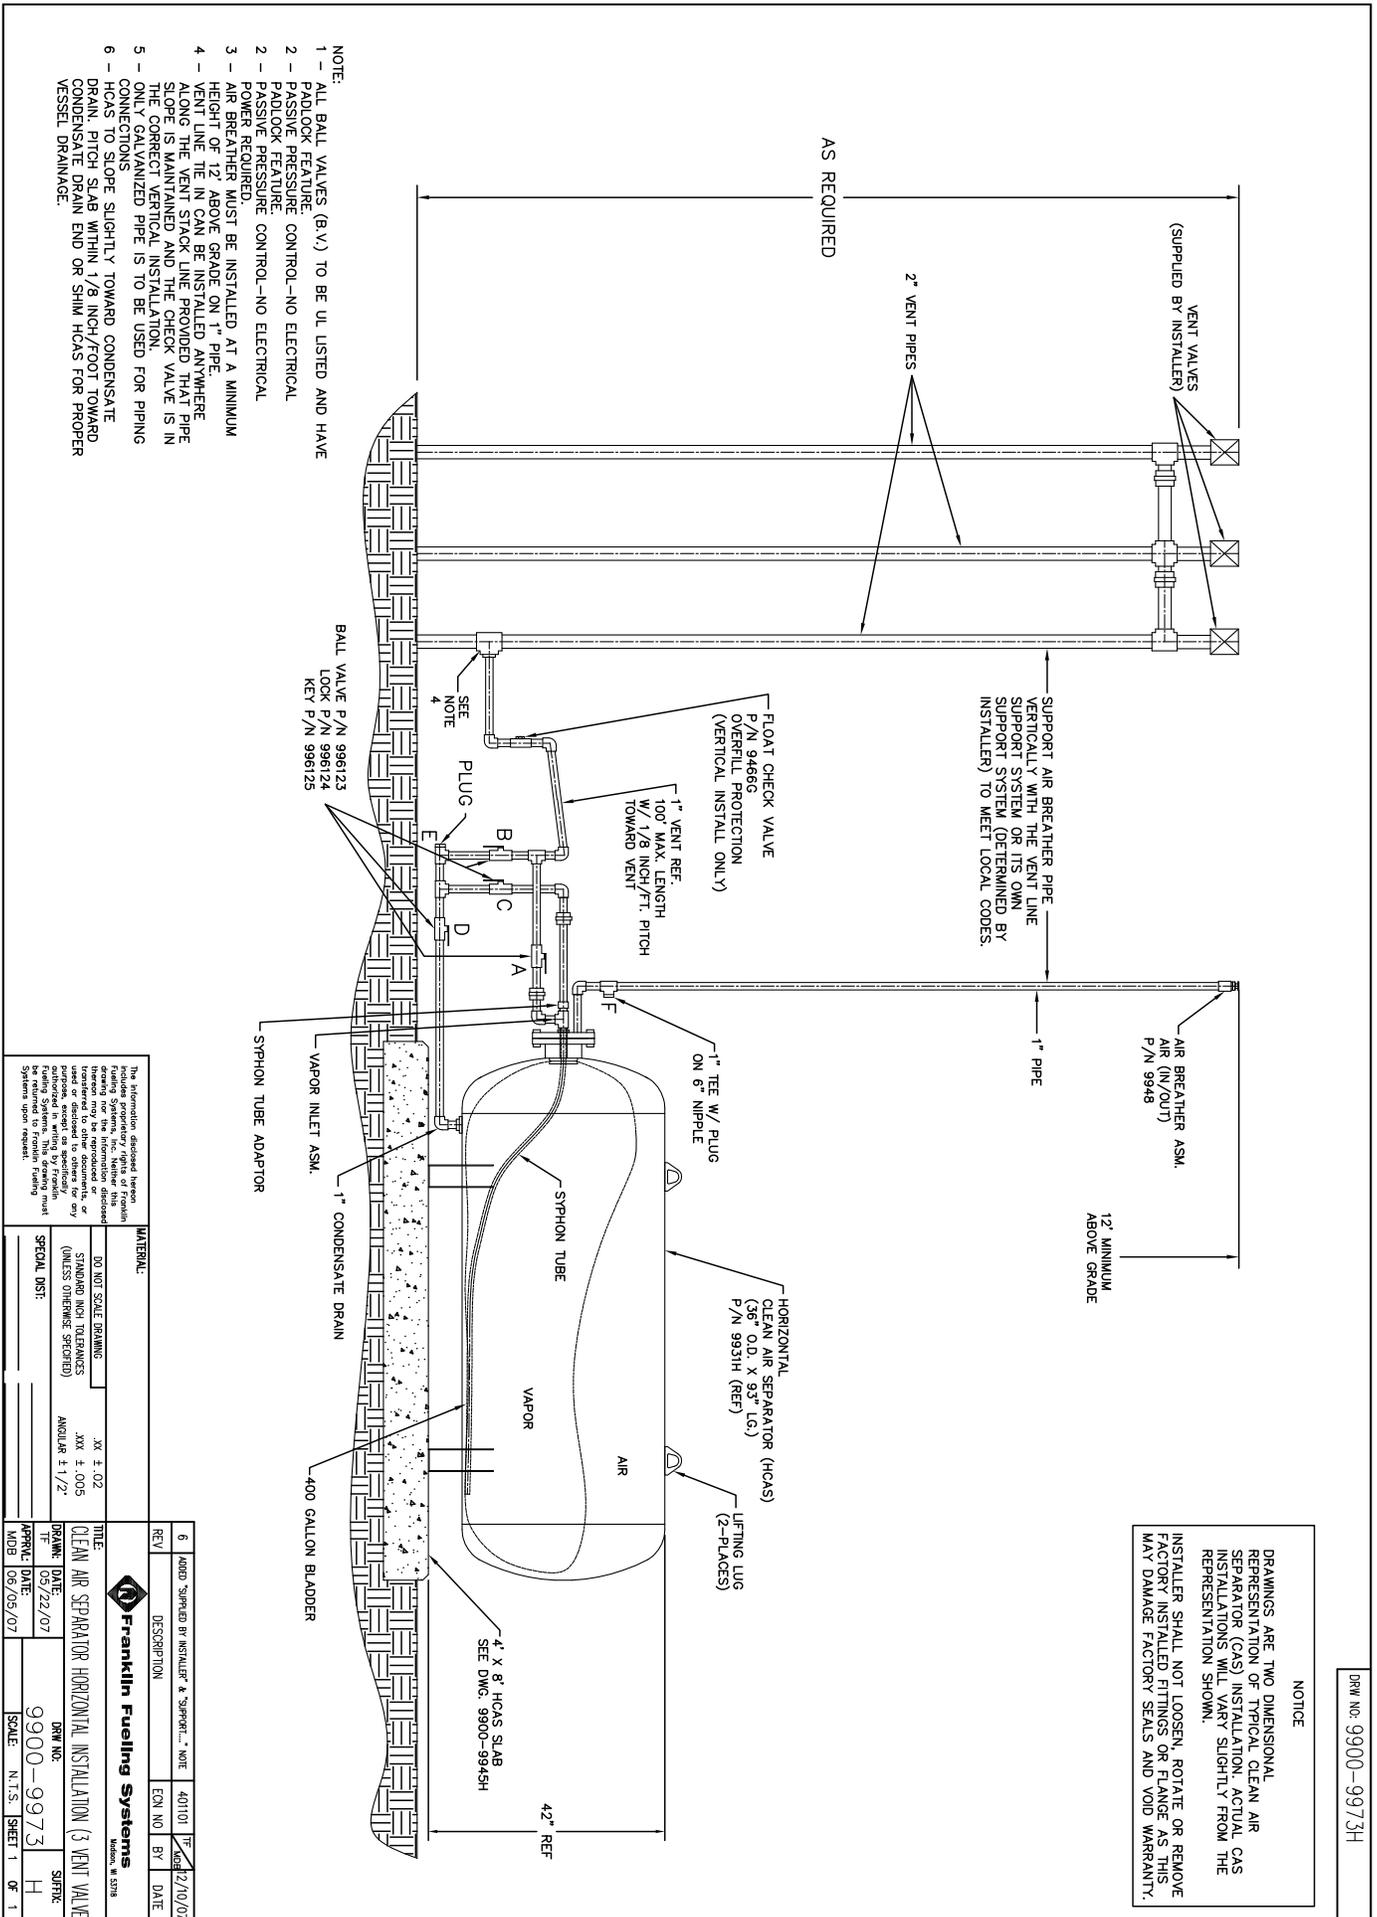

- NOTE:
- 1 – ALL BALL VALVES (B.V.) TO BE UL LISTED AND HAVE PADLOCK FEATURE CONTROL-NO ELECTRICAL
 - 2 – PASSIVE PRESSURE CONTROL-NO ELECTRICAL
 - 3 – AIR BREATHER MUST BE INSTALLED AT A MINIMUM HEIGHT OF 12" ABOVE GRADE ON 1" PIPE.
 - 4 – VENT LINE THE IN CAN BE INSTALLED ANYWHERE ALONG THE VENT STACK LINE PROVIDED THAT PIPE SLOPE IS MAINTAINED AND THE CHECK VALVE IS IN THE CORRECT VERTICAL INSTALLATION.
 - 5 – ONLY GALVANIZED PIPE IS TO BE USED FOR PIPING CONNECTIONS
 - 6 – HCAS TO SLOPE SLIGHTLY TOWARD CONDENSATE DRAIN, PITCH SLAB WITHIN 1/8 INCH/FOOT TOWARD CONDENSATE DRAIN END OR SHIM HCAS FOR PROPER VESSEL DRAINAGE.

NOTICE

DRAWINGS ARE TWO DIMENSIONAL REPRESENTATION OF TYPICAL CLEAN AIR SEPARATOR (CAS) INSTALLATION. ACTUAL CAS INSTALLATIONS WILL VARY SLIGHTLY FROM THE REPRESENTATION SHOWN.

INSTALLER SHALL NOT LOOSEN, ROTATE OR REMOVE FACTORY INSTALLED FITTINGS OR FLANGE AS THIS MAY DAMAGE FACTORY SEALS AND VOID WARRANTY.

The information disclosed herein includes proprietary rights of Franklin Fueling Systems, Inc. and is intended for use only for the information disclosed herein. It is not to be reproduced or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Franklin Fueling Systems, Inc. This drawing must be used as a guide only. Franklin Fueling Systems, Inc. is not responsible for any damage or injury resulting from the use of this drawing without the prior written permission of Franklin Fueling Systems, Inc.

MATERIAL:	
DO NOT SCALE DRAWING	XX ± .02
STANDARD NICK TOLERANCES (UNLESS OTHERWISE SPECIFIED)	.XXX ± .005
SPECIAL DST:	ANGULAR ± 1/2°

TITLE:		REV	
CLEAN AIR SEPARATOR HORIZONTAL INSTALLATION (3 VENT VALVE)		6	401101
DRAWN BY:	DATE:	DESCRIPTION	DATE
TF	05/22/07		2/10/07
APPROVED BY:	DATE:	EON NO	BY
MOB	05/05/07		
SCALE: N.T.S.		SHEET 1 OF 1	



Model B 5218

DRW NO: 9900-9973H